




Ammonia

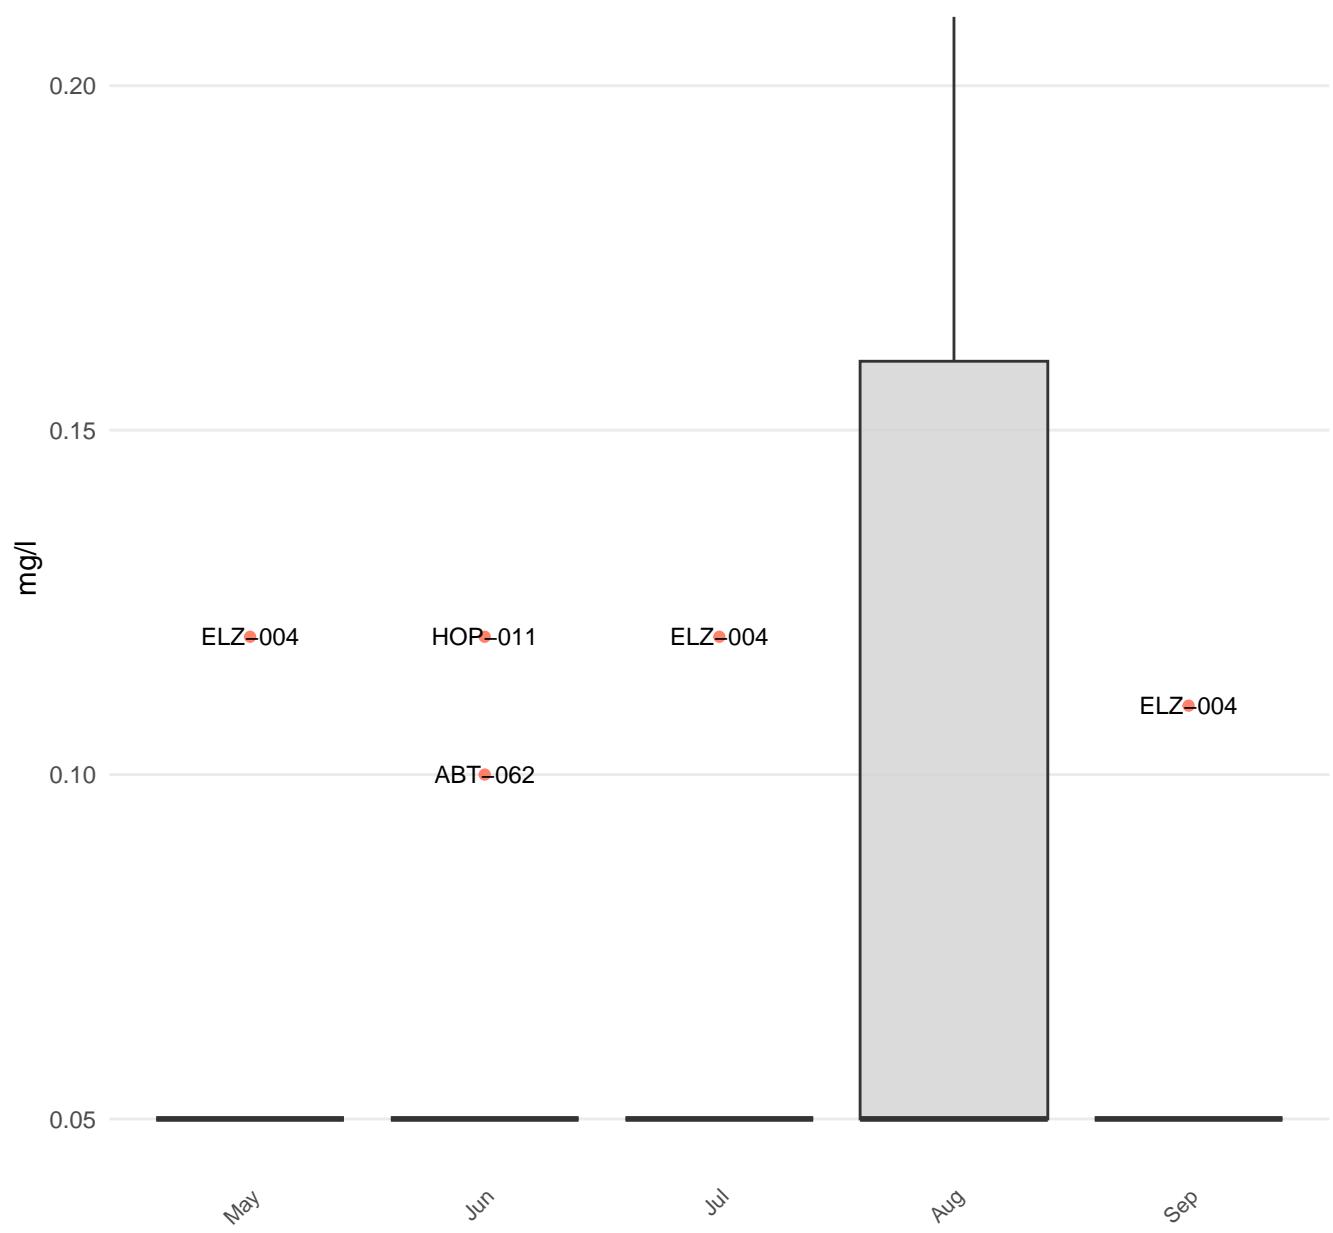


DO

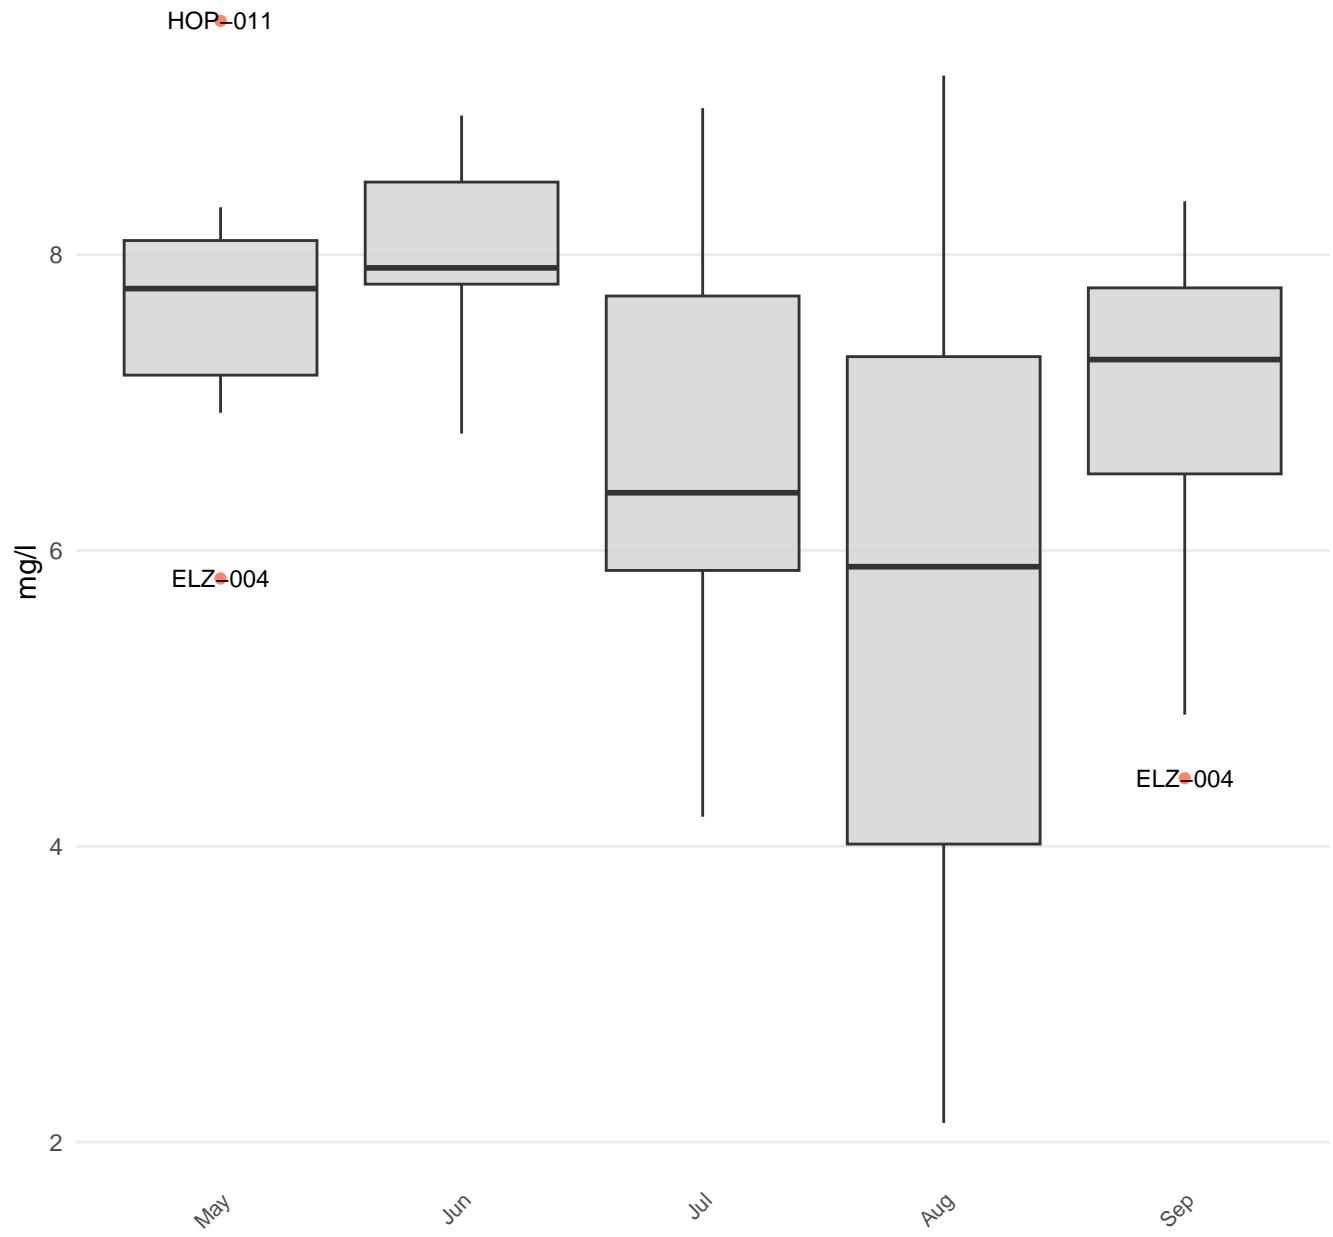


E.coli

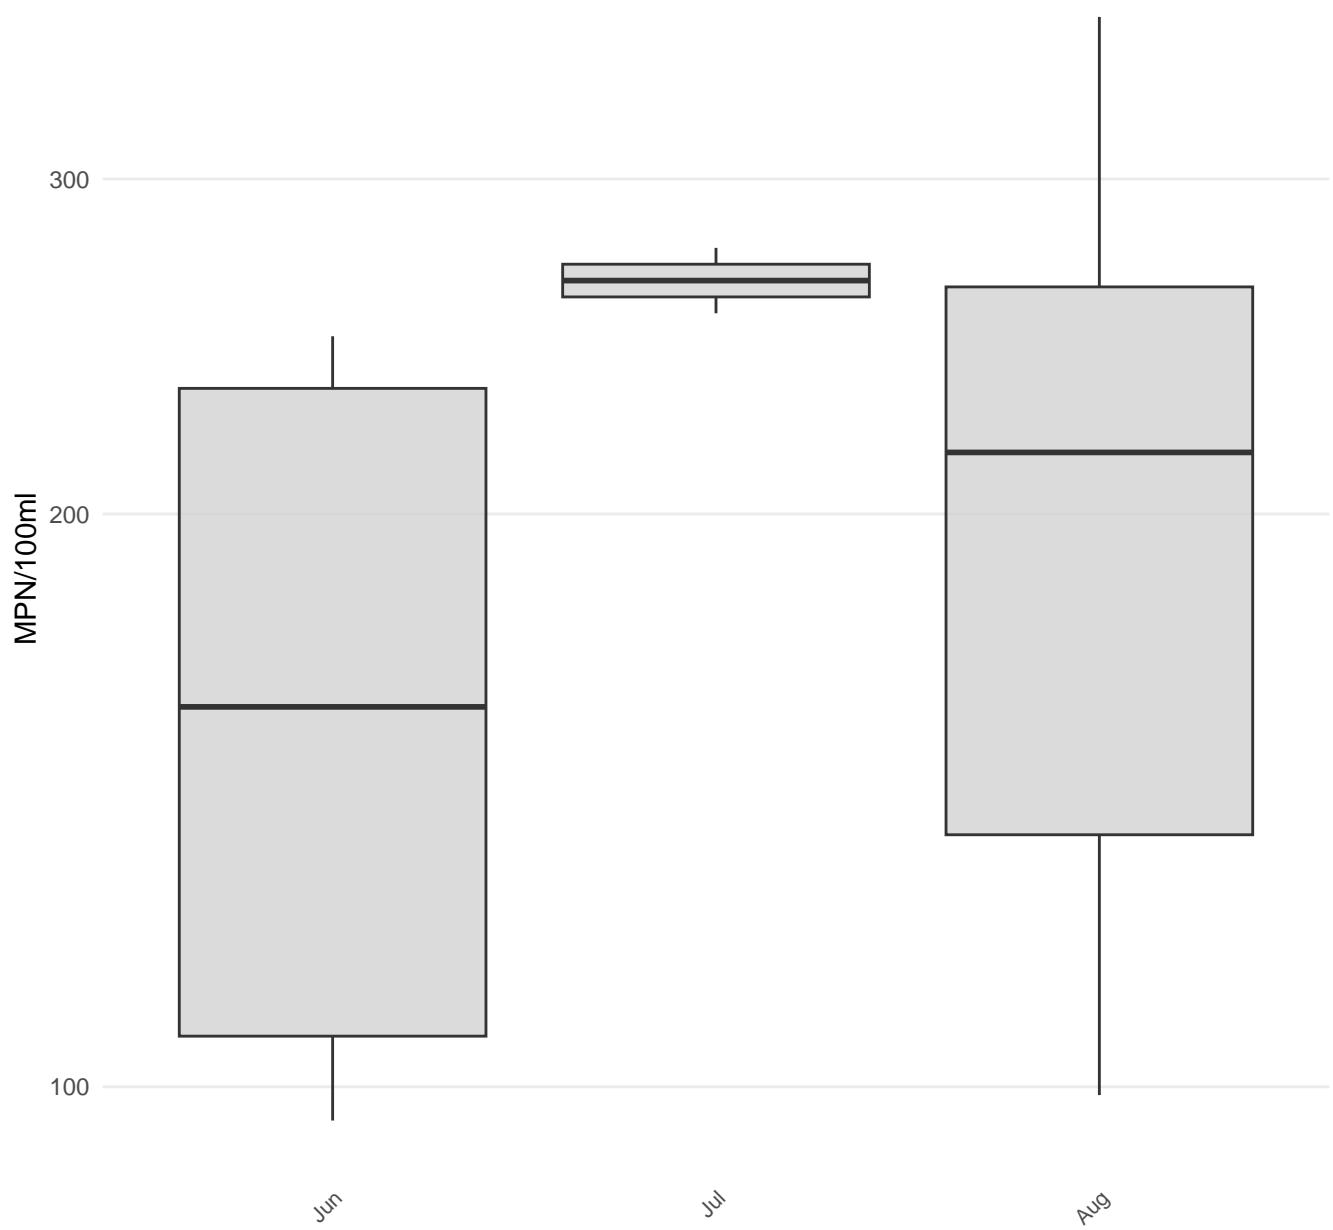


Nitrate

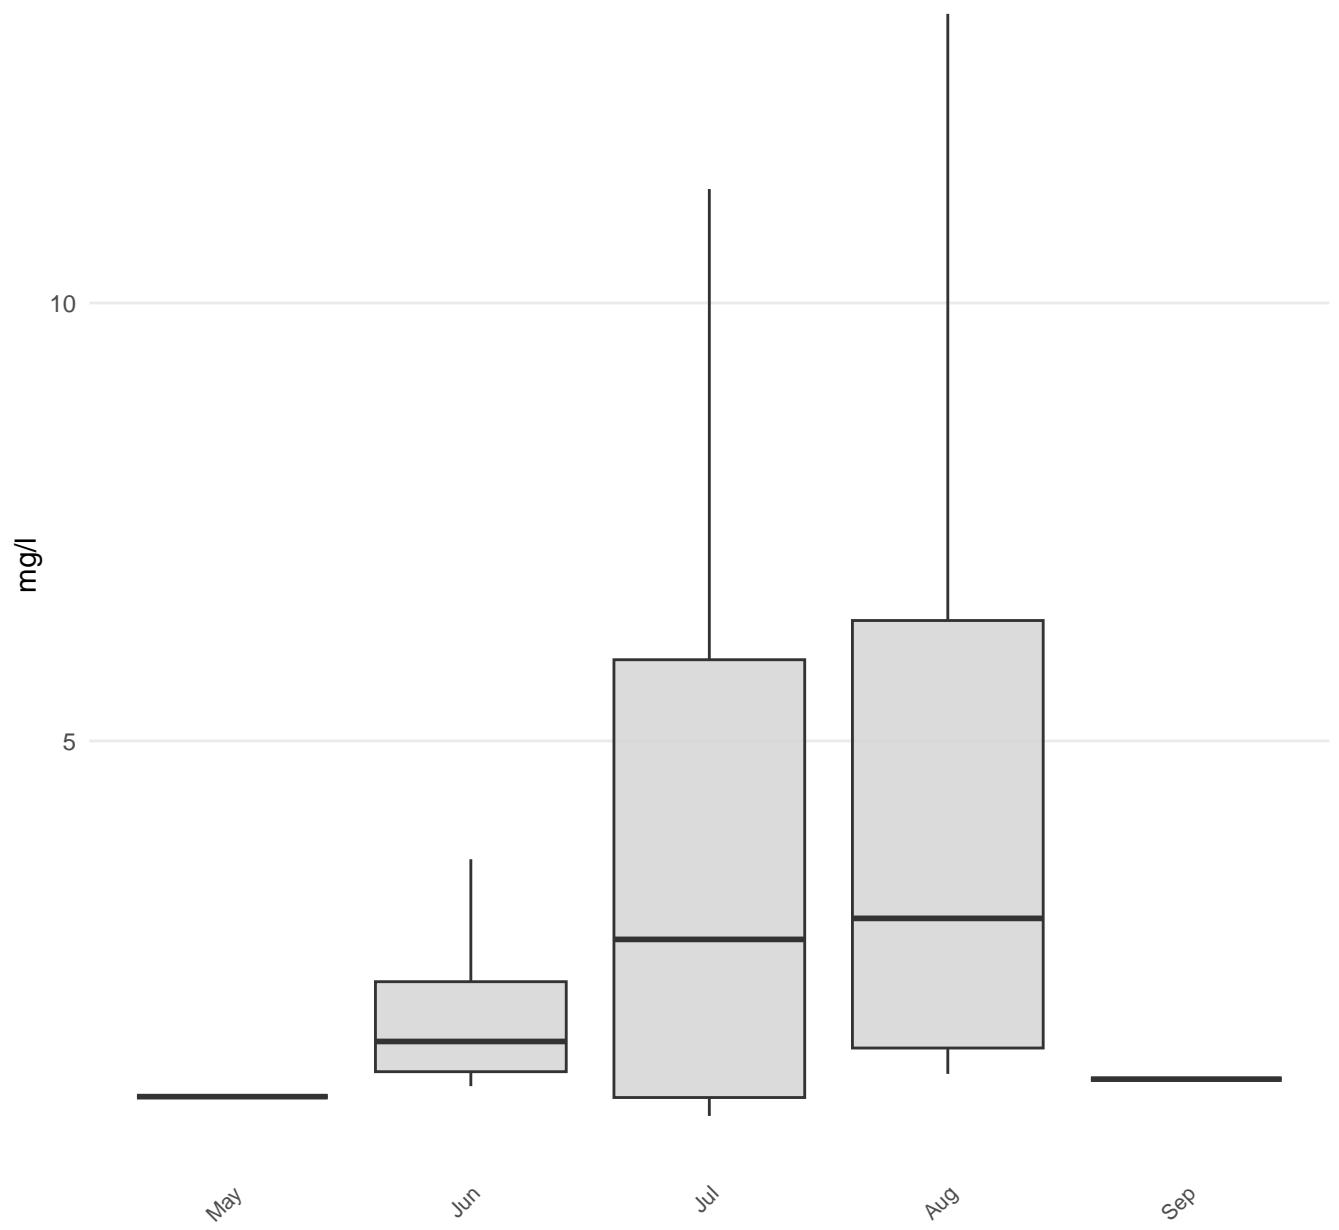


Sp Conductance

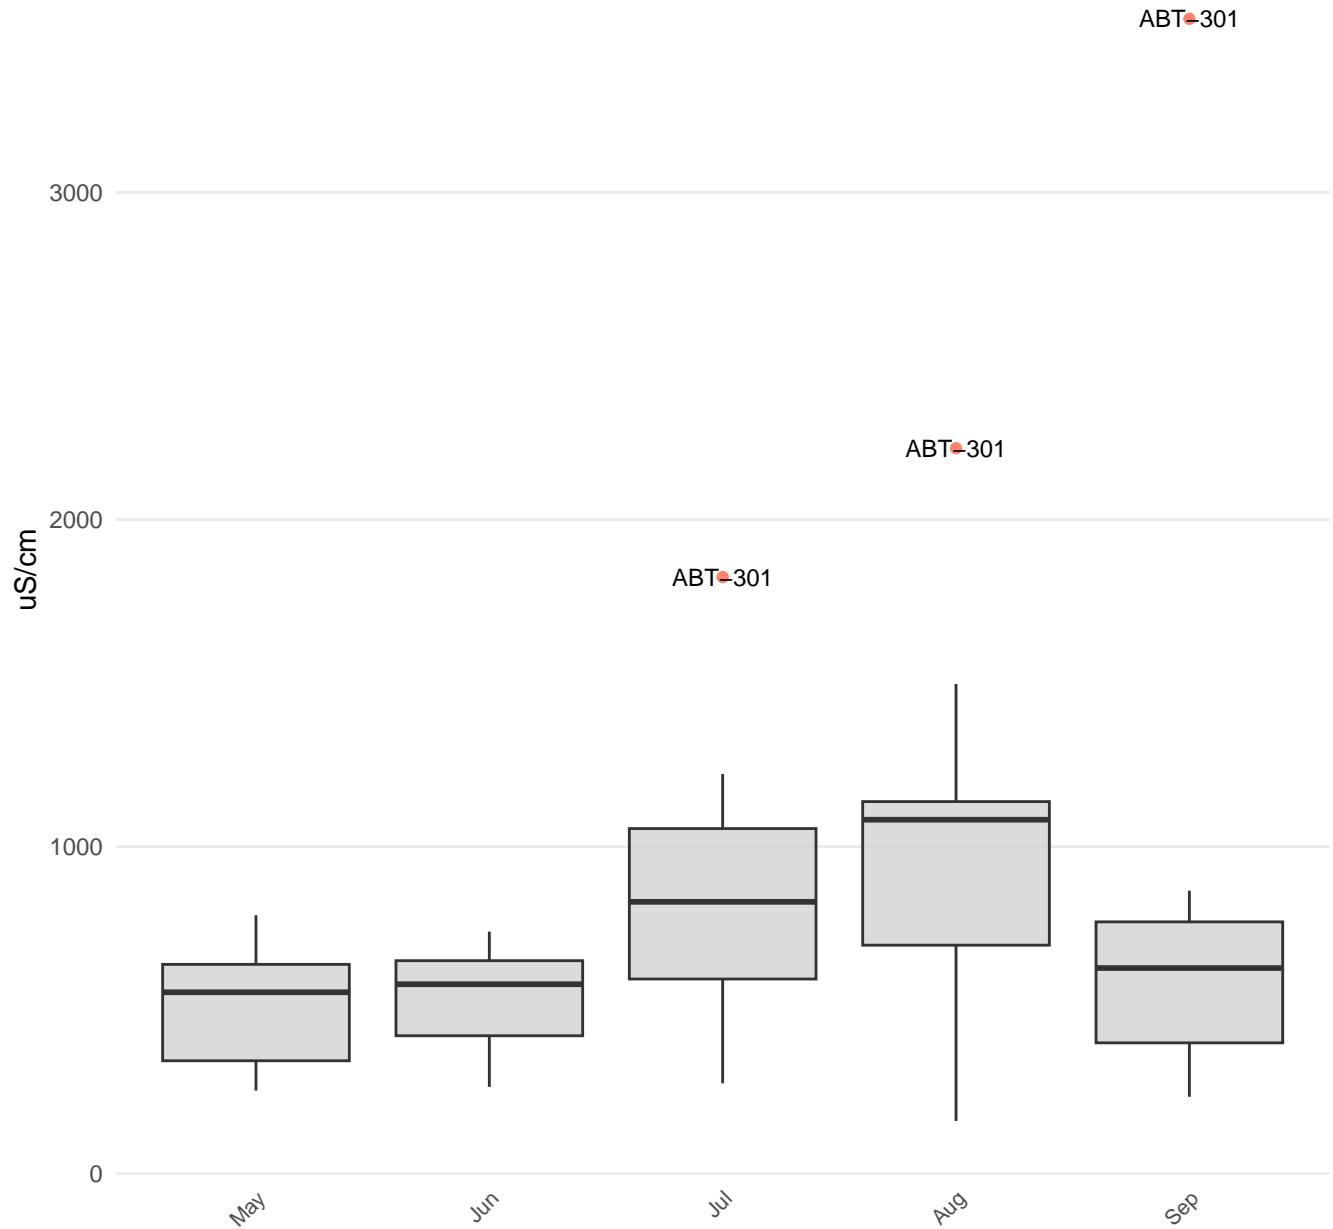


TP

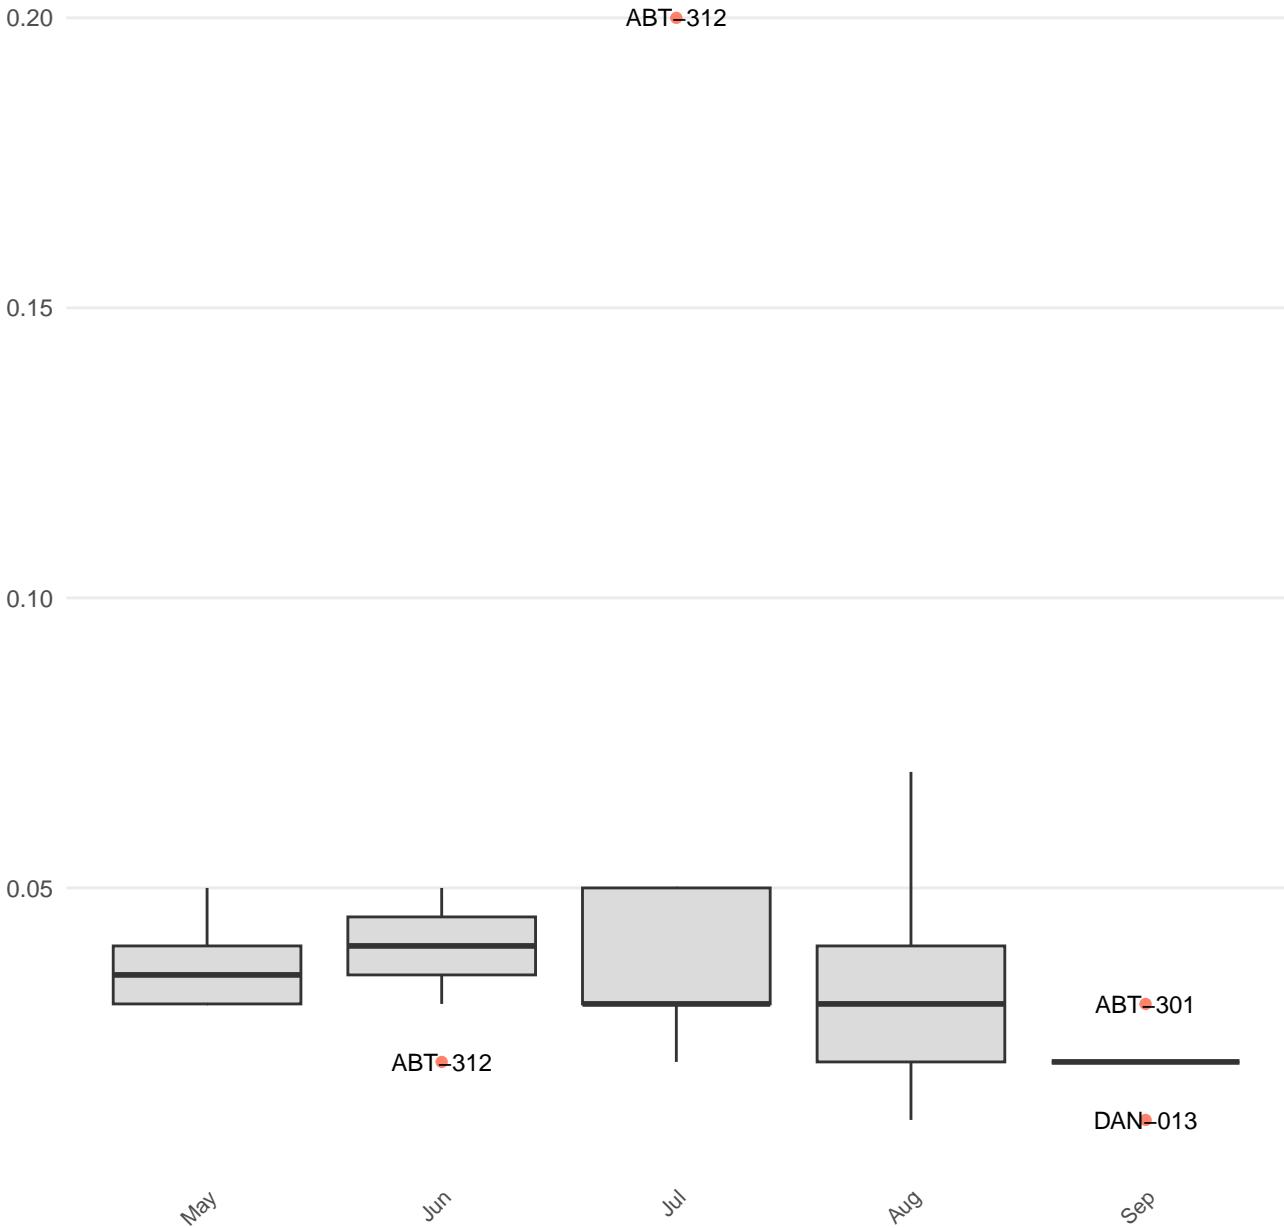


Water Temp

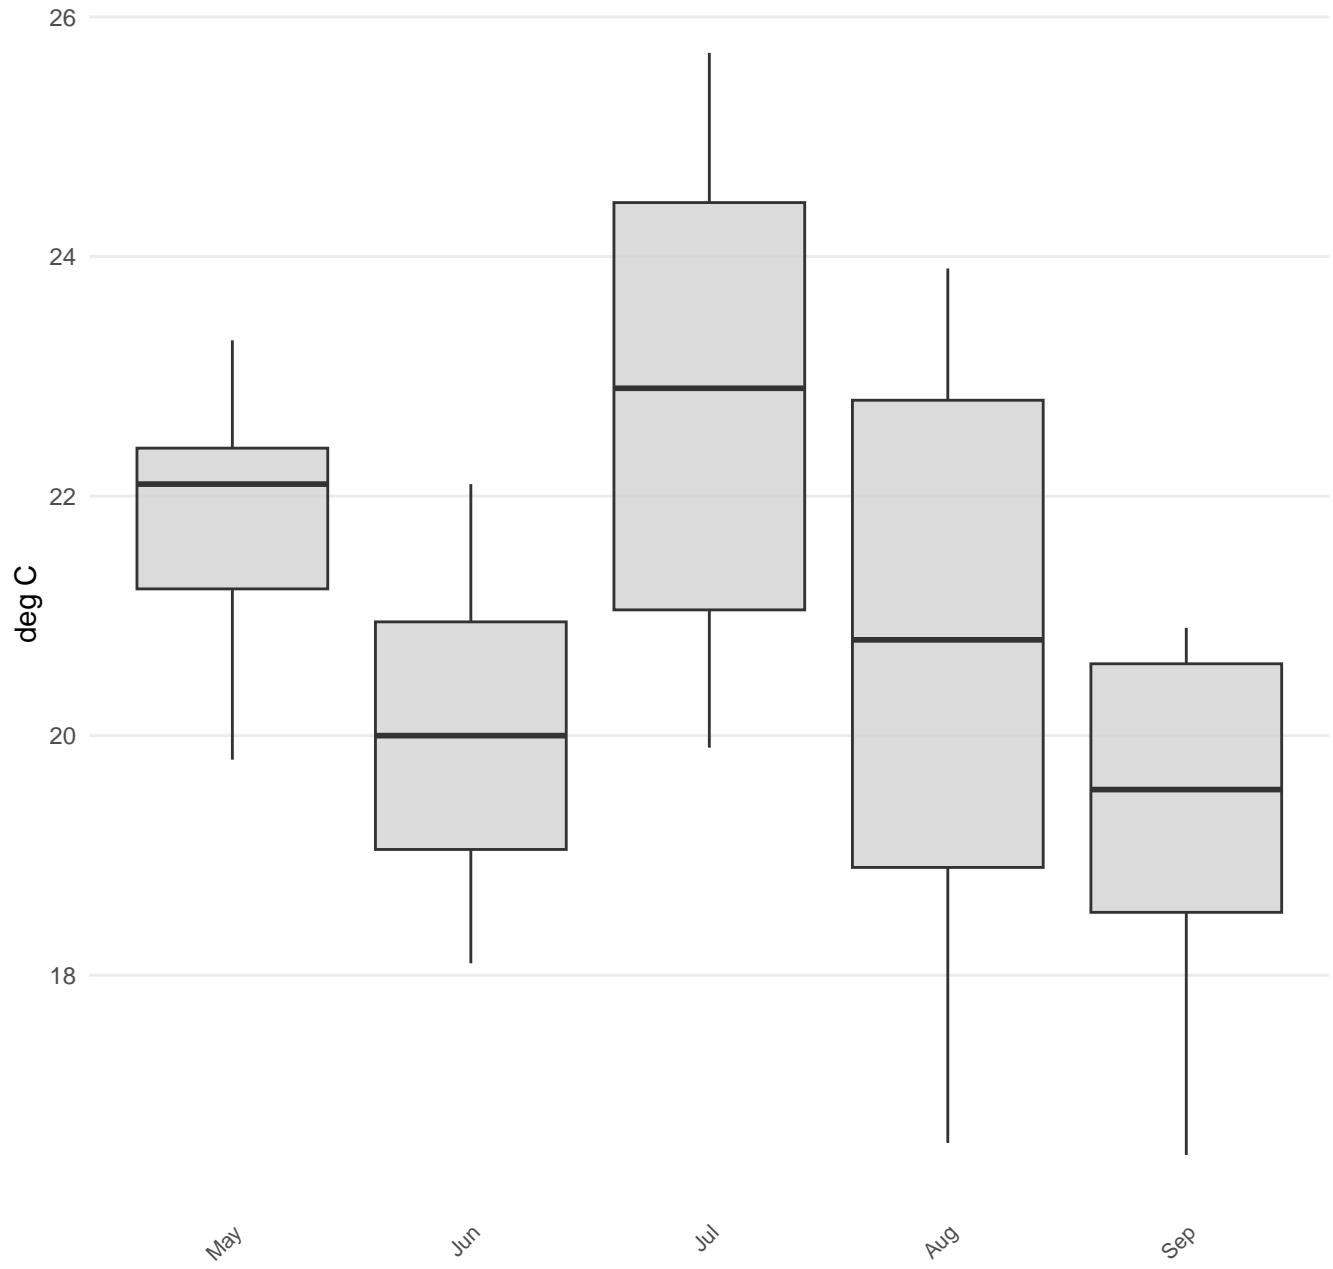


pH

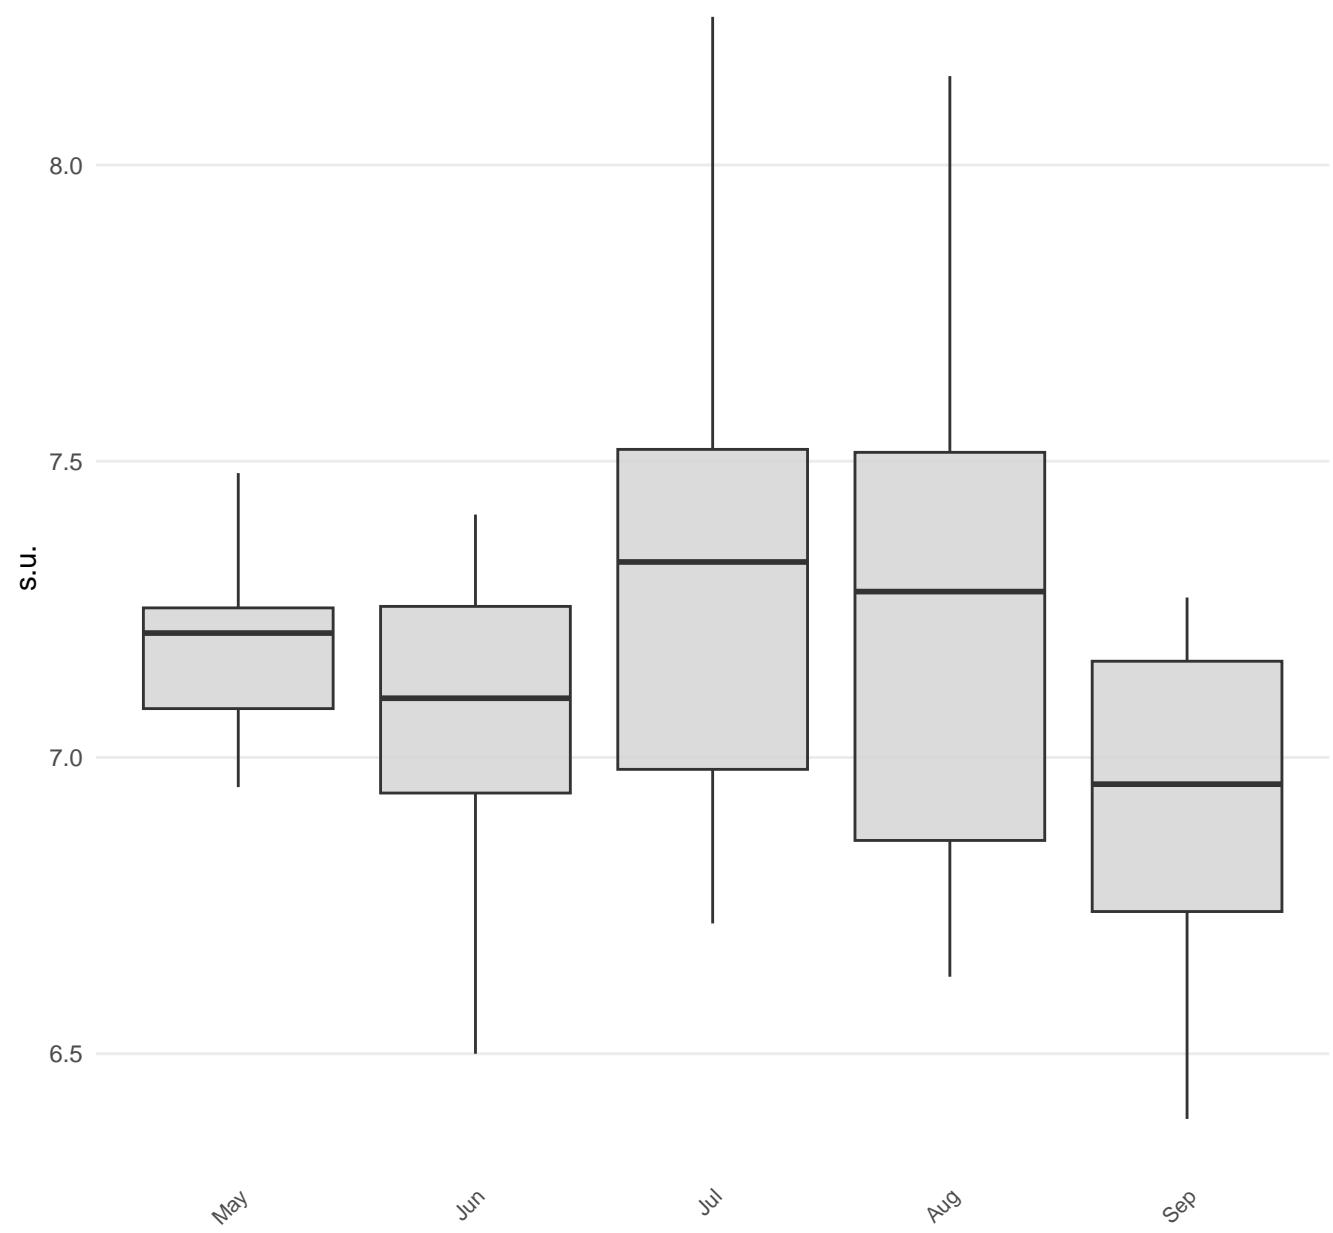

Ammonia

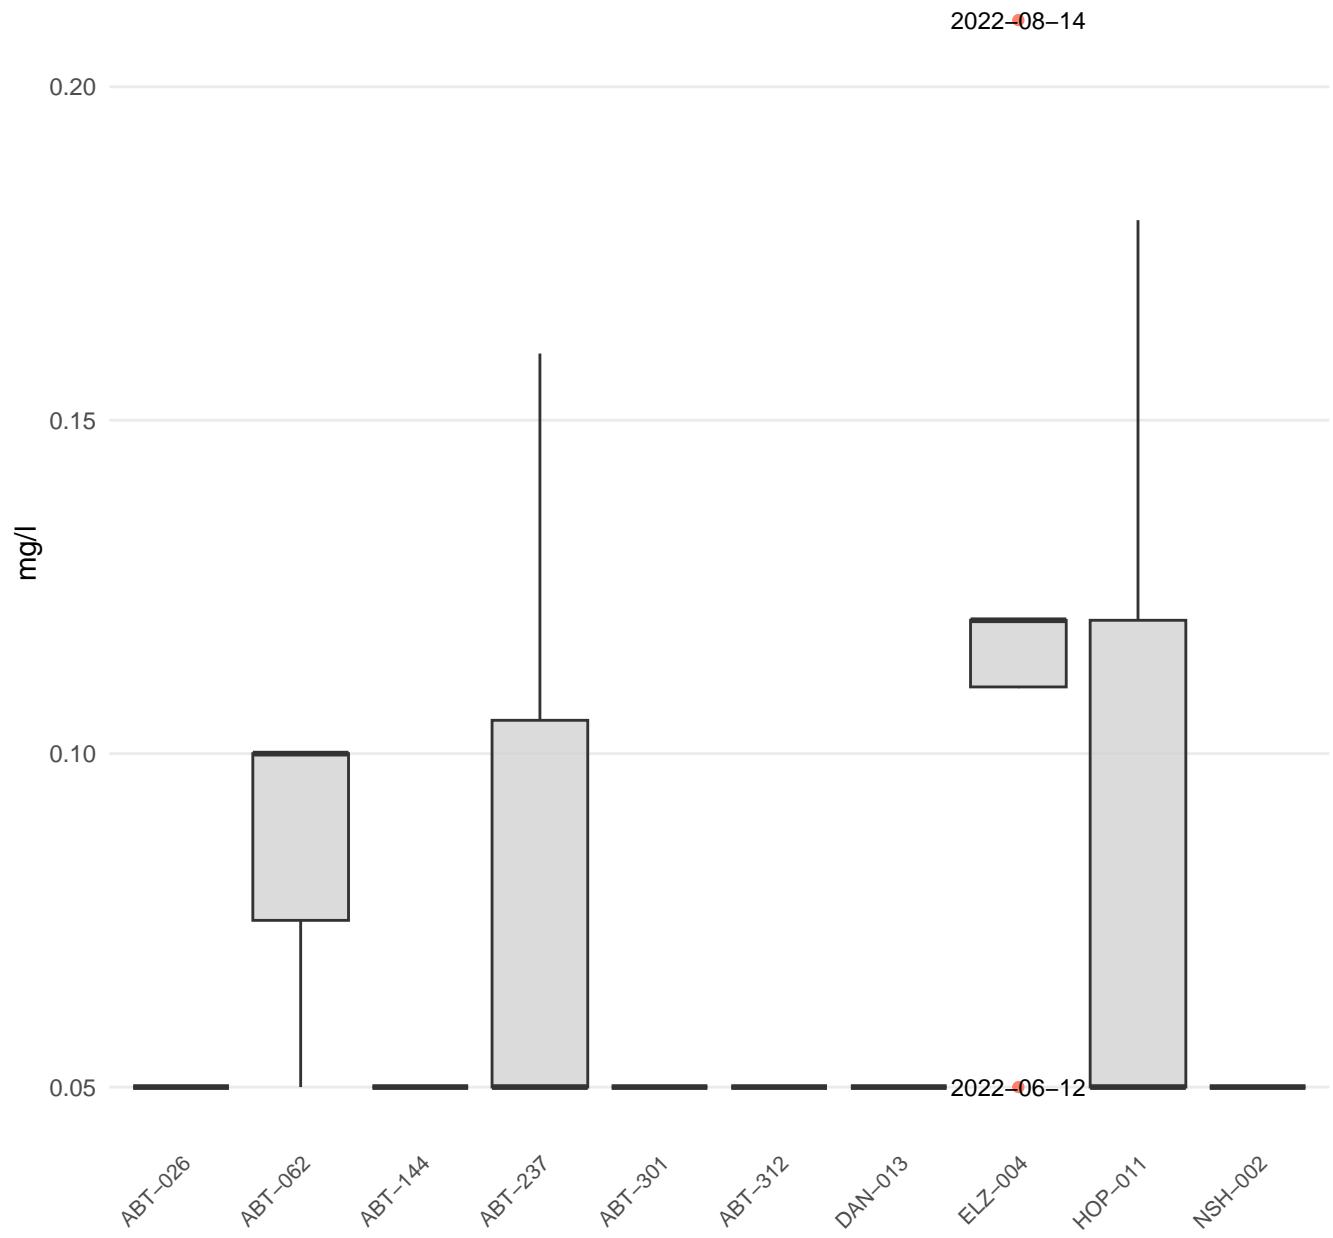


DO

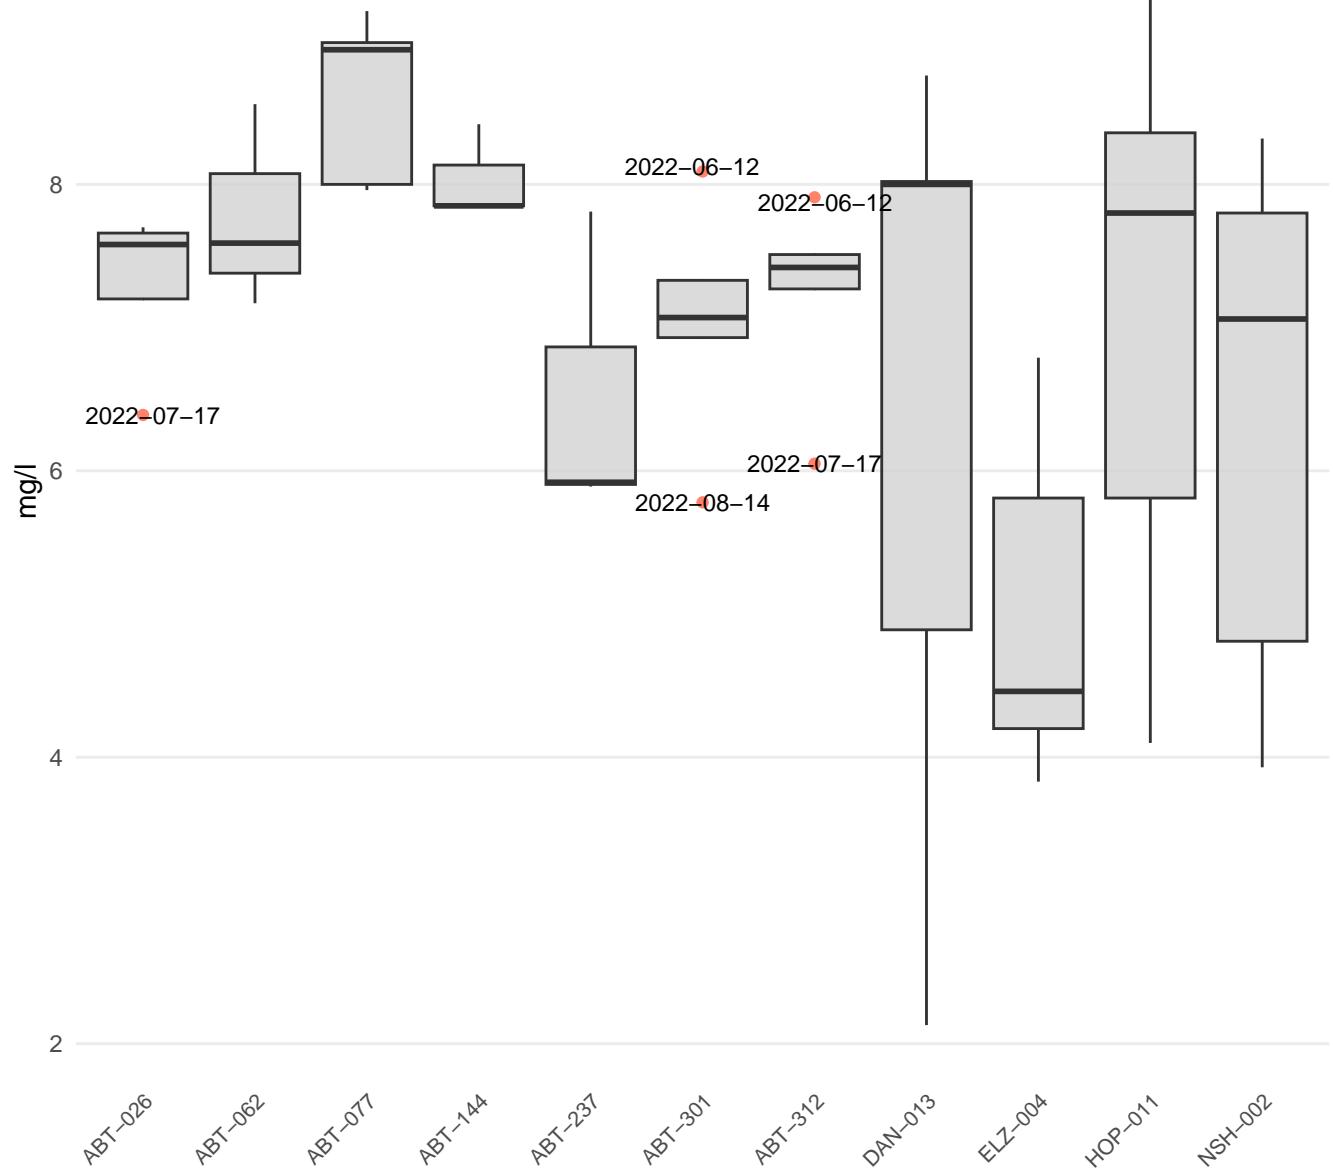


E.coli


2022-08-29

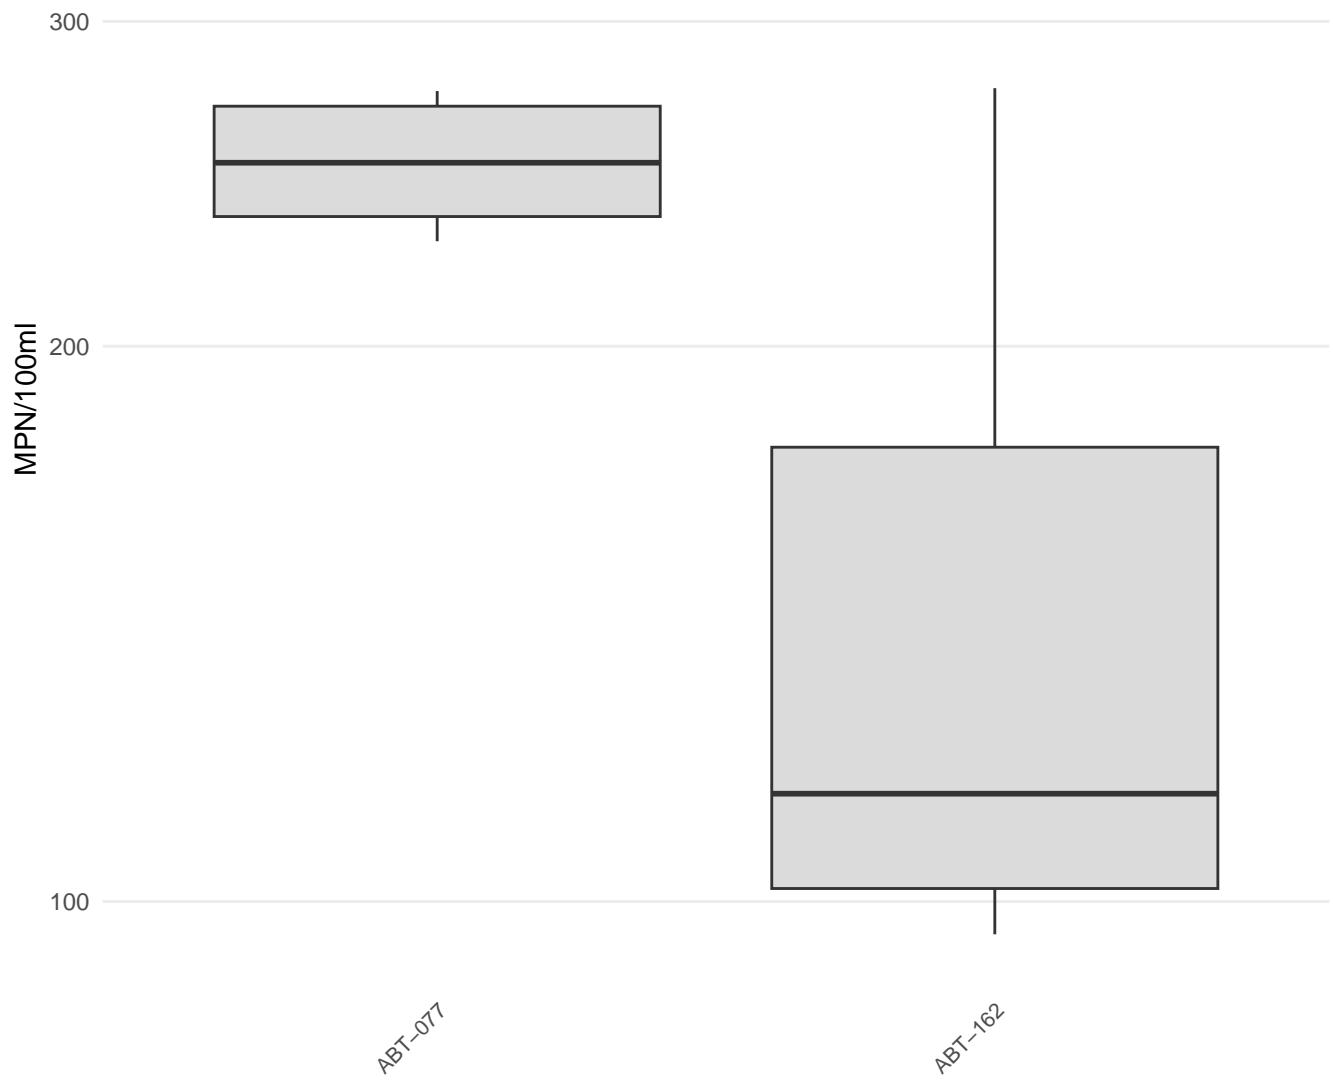

Nitrate

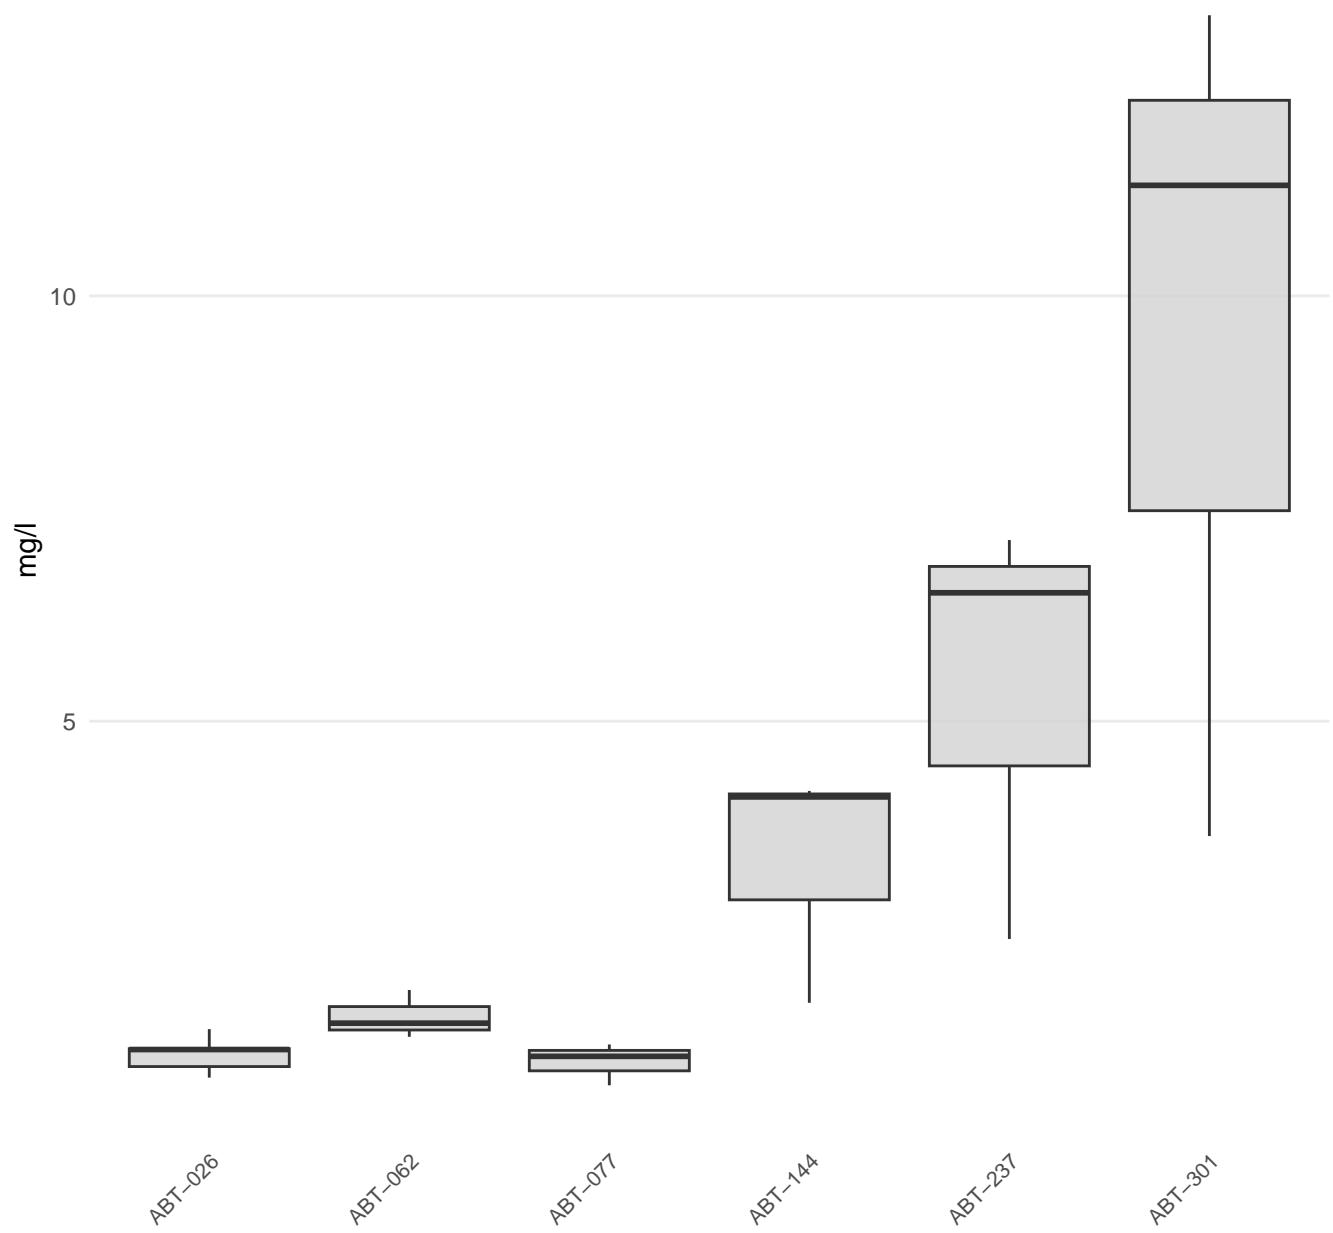

Sp Conductance

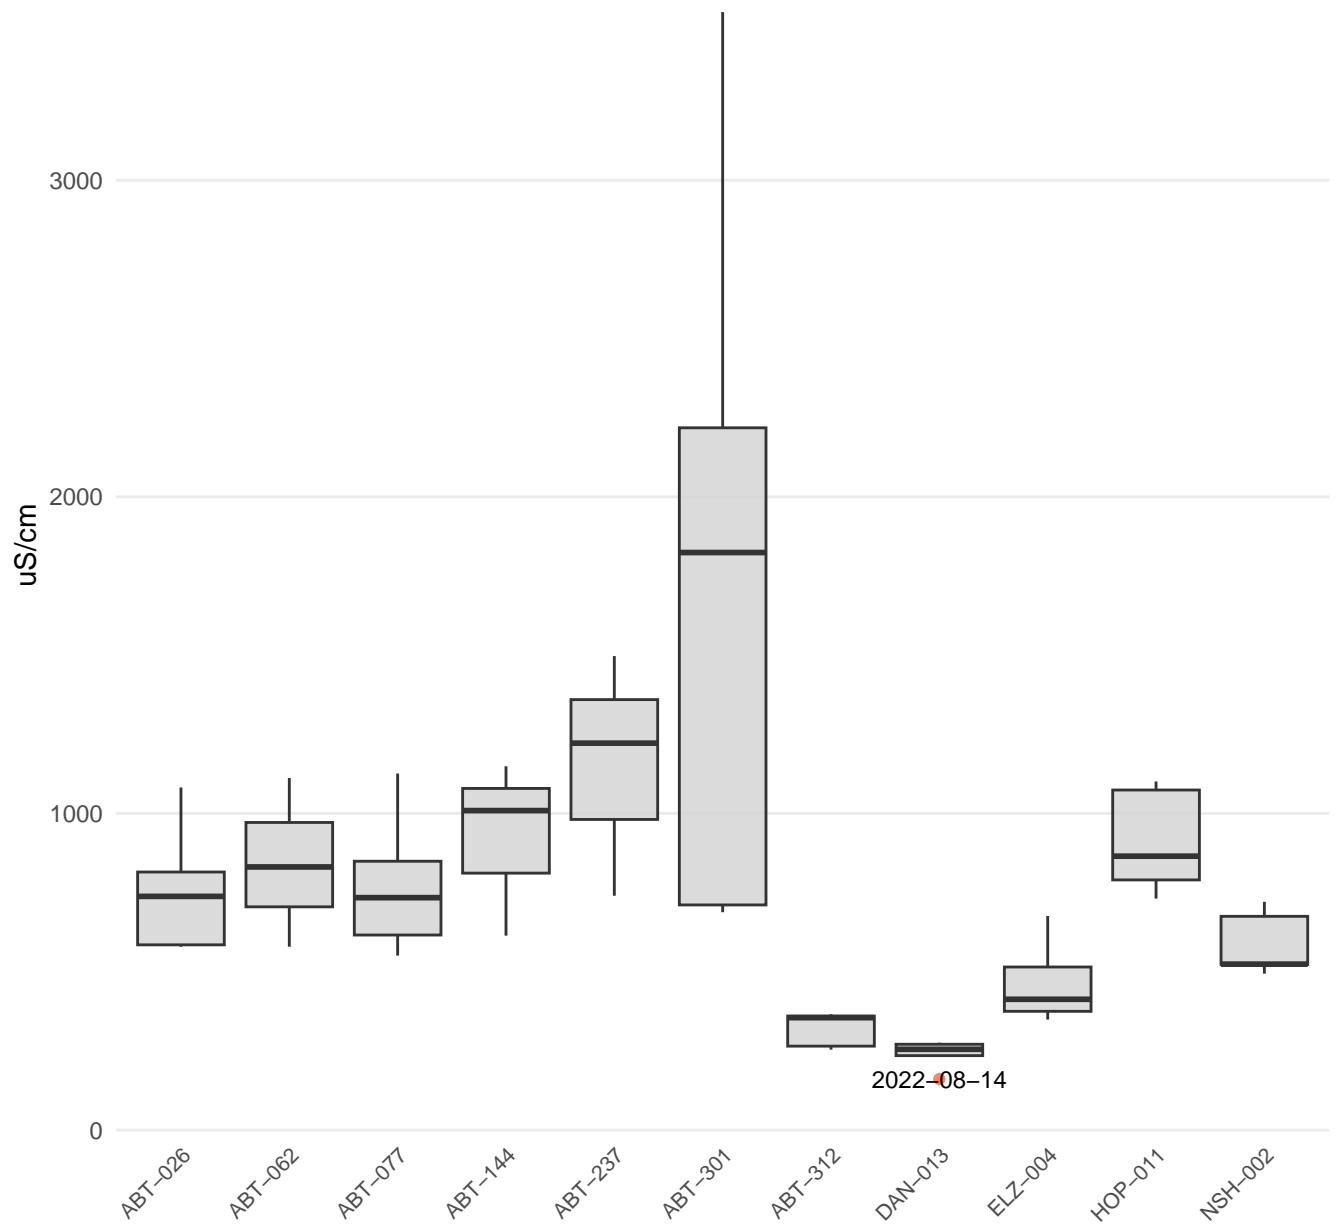

TP

0.20 2022-07-17

0.15

mg/l

0.10

0.05

2022-09-11

ABT-026

ABT-062

ABT-077

ABT-144

ABT-237

ABT-301


ABT-312

DAN-013


ELZ-004

HOP-011


NSH-002

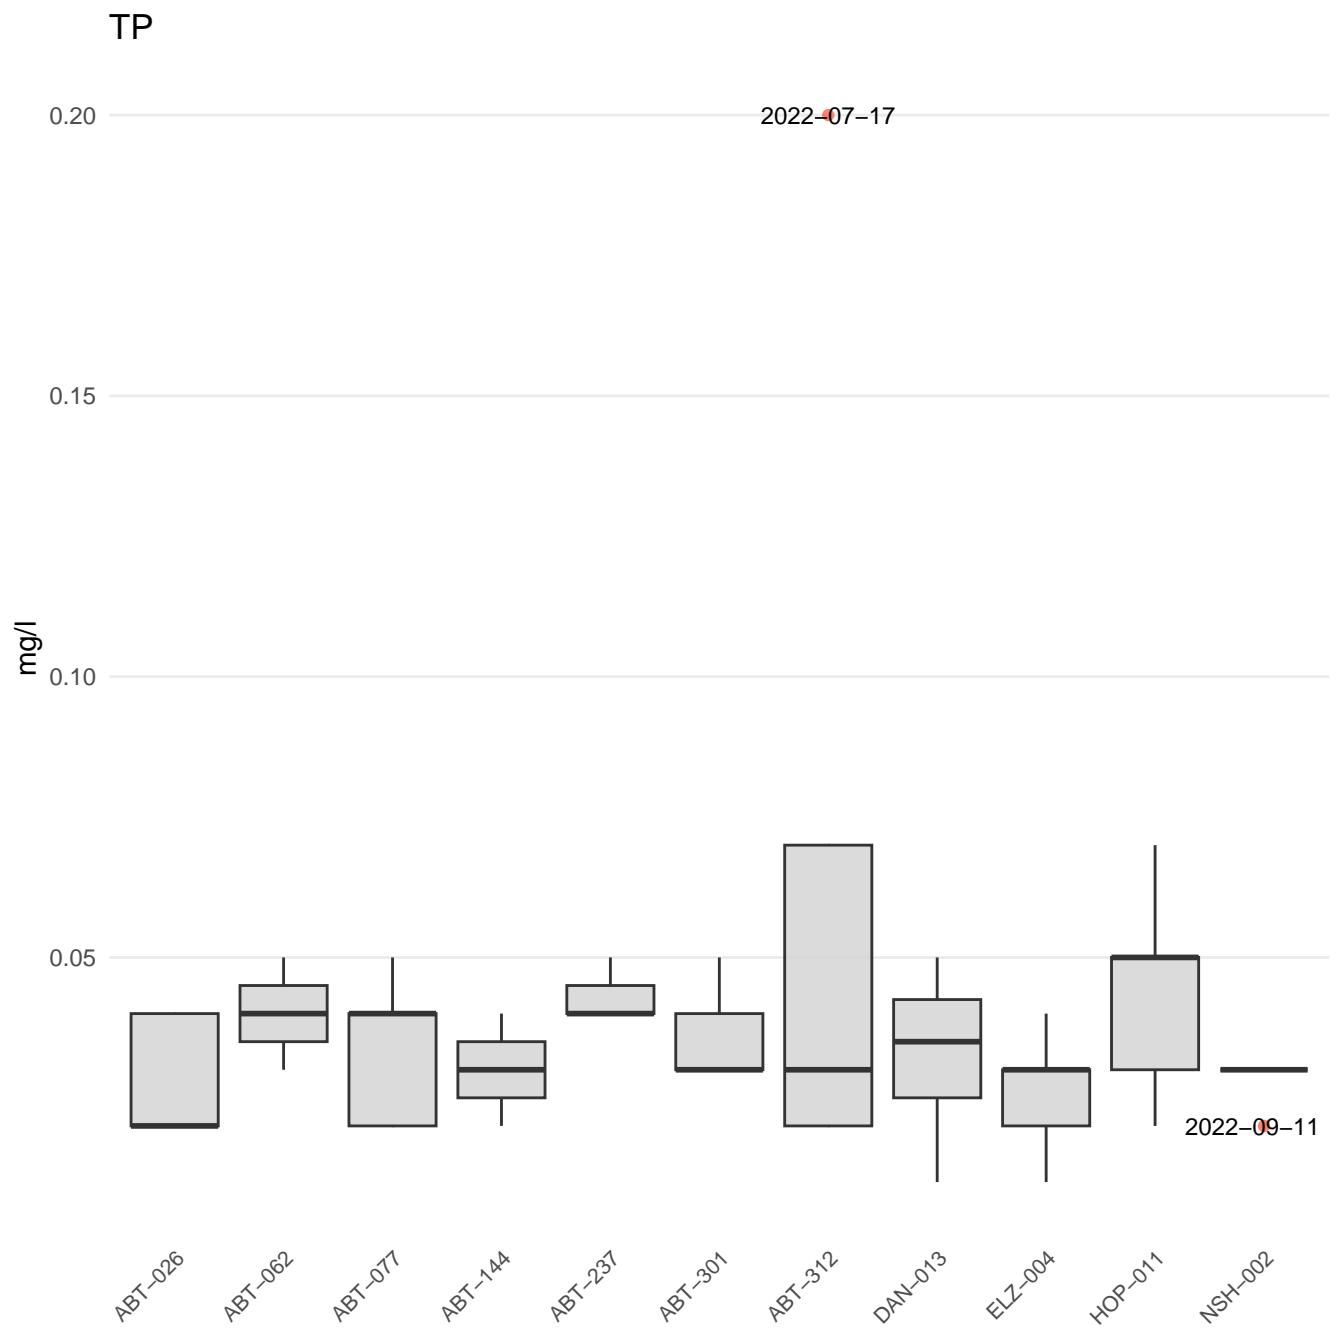


Water Temp

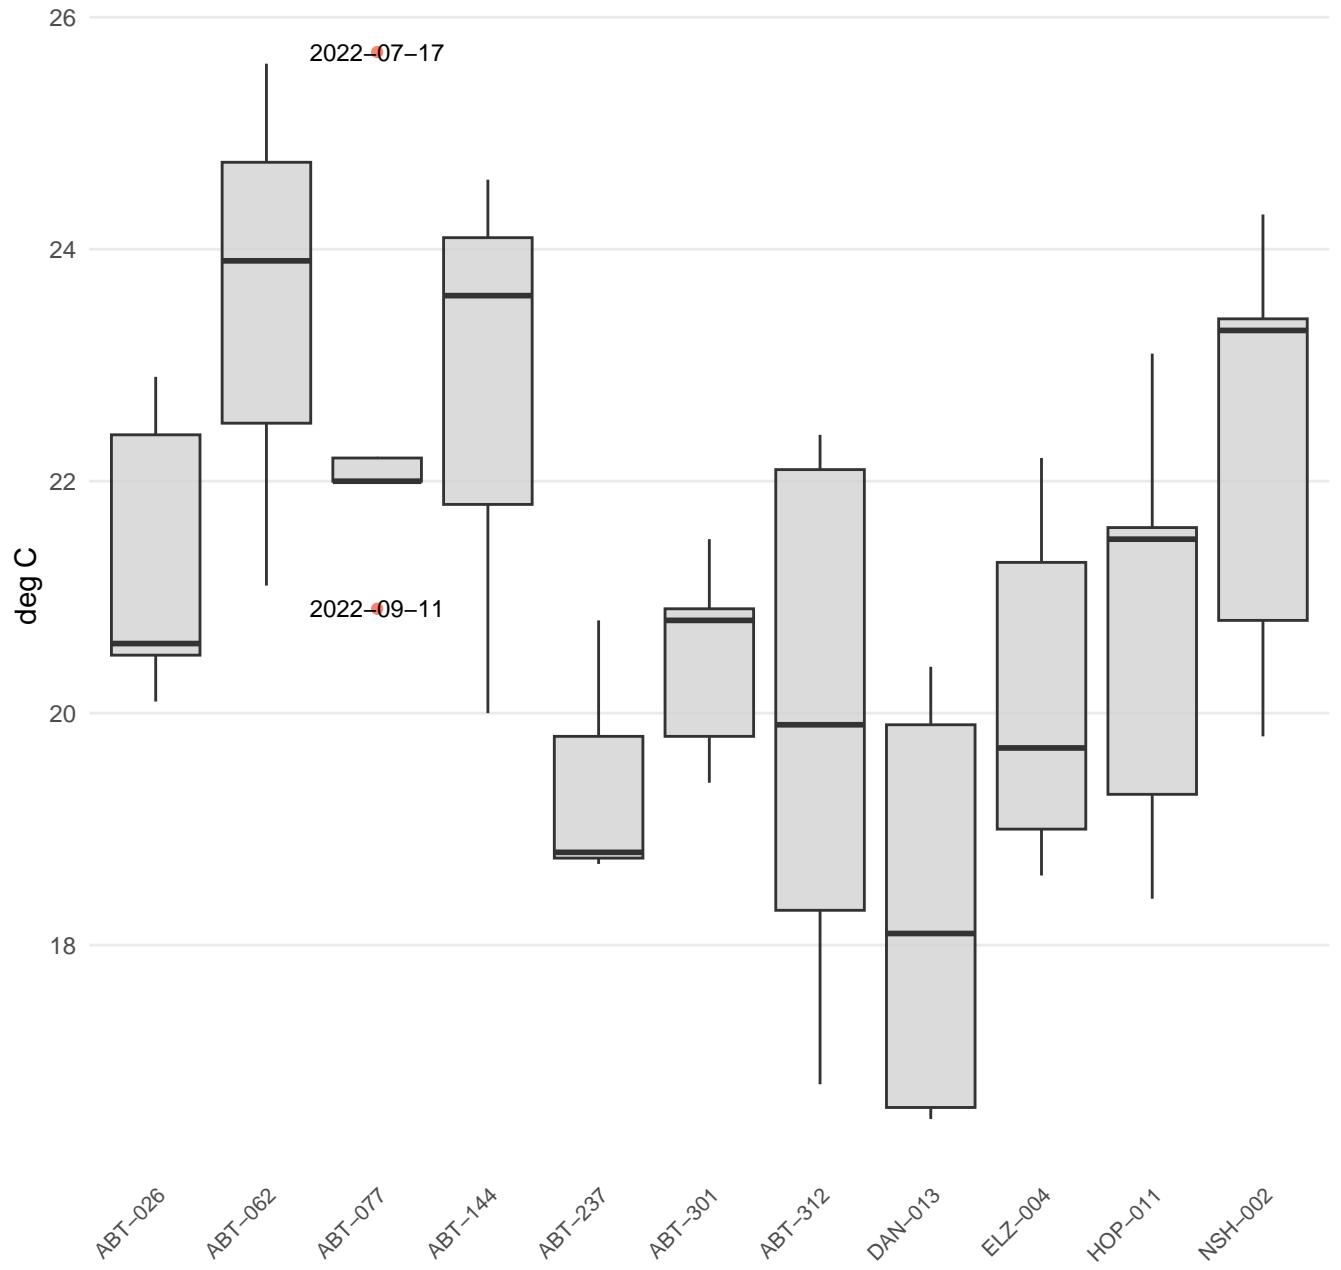


pH

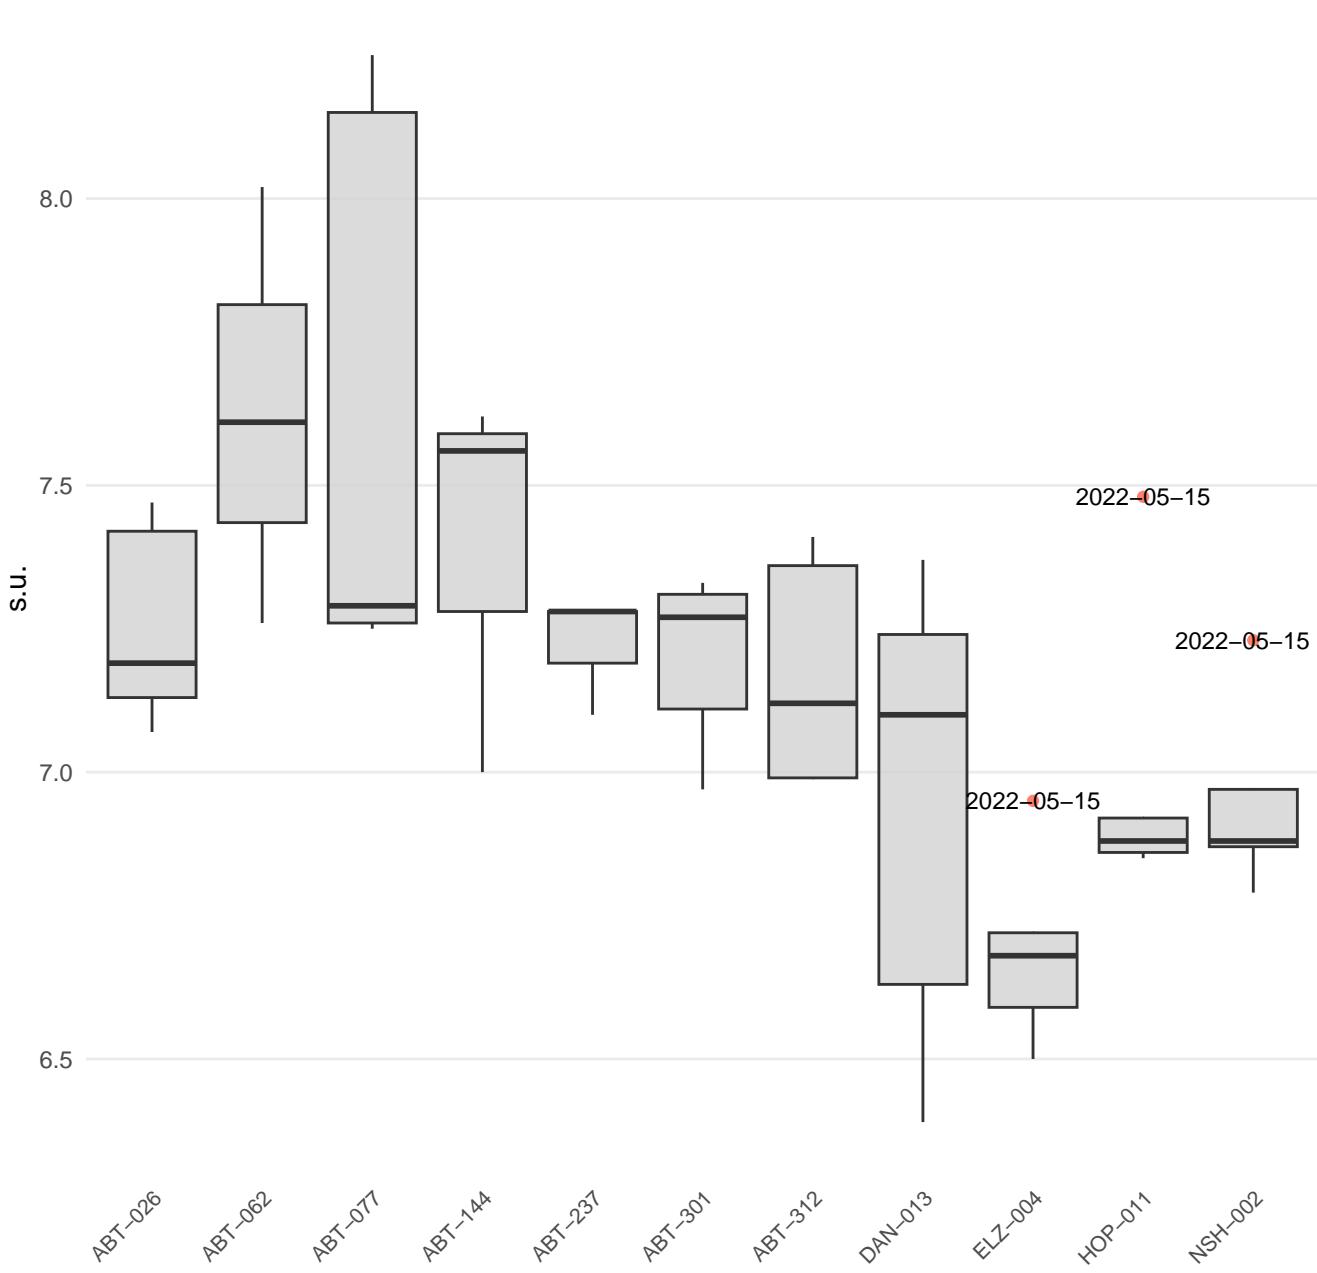


Ammonia

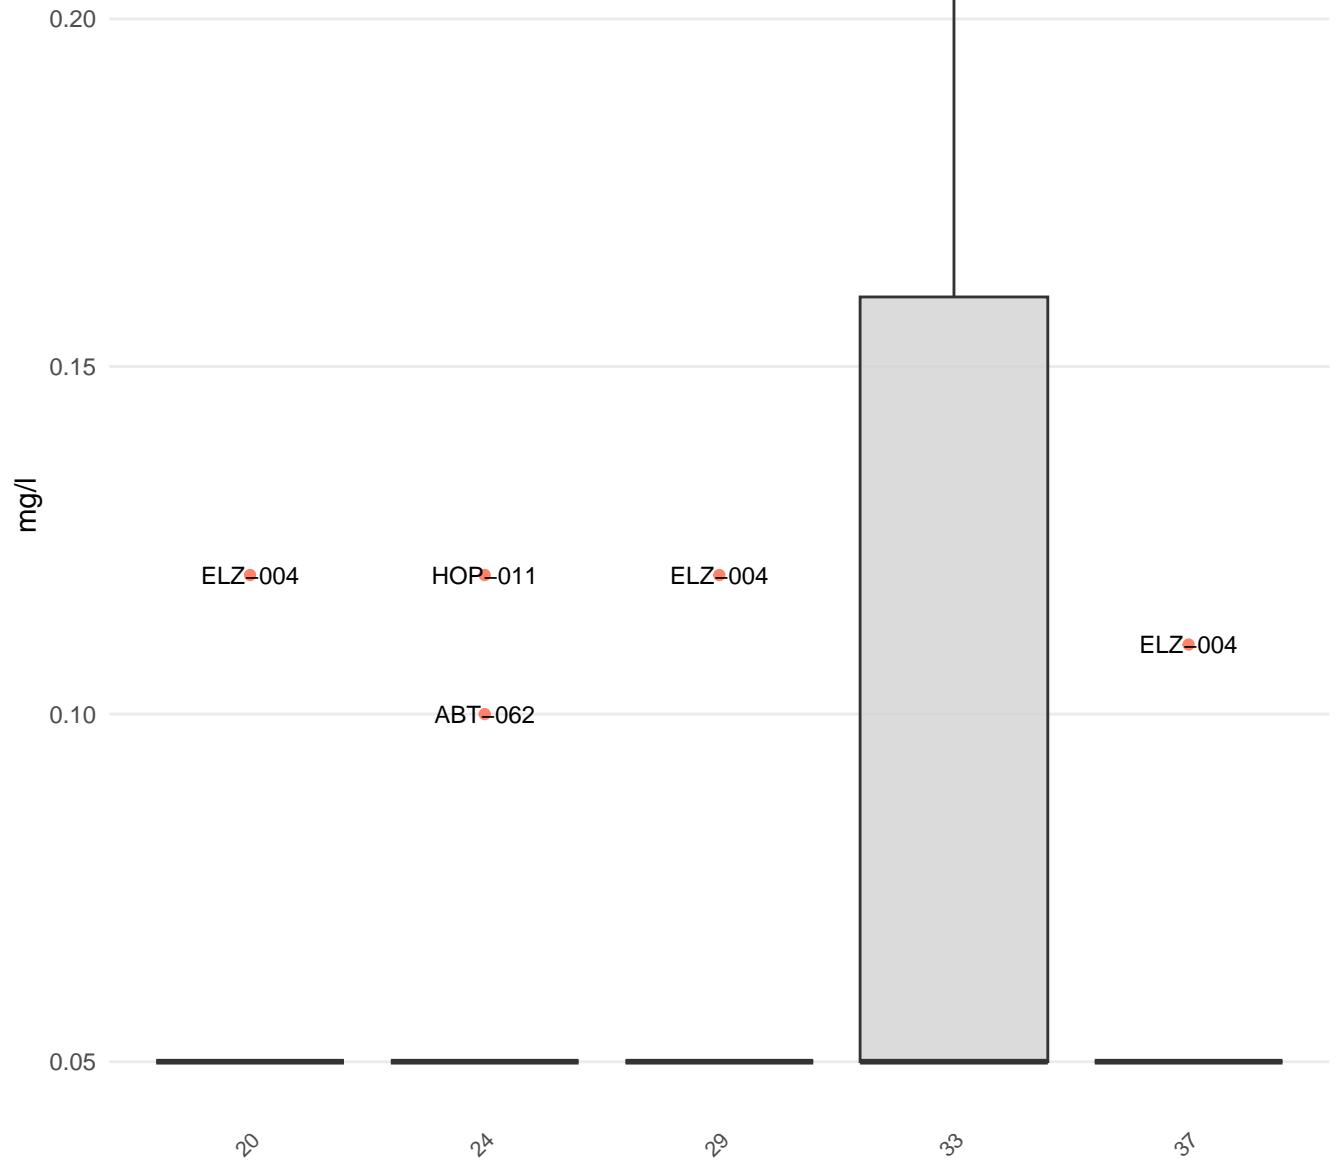


DO

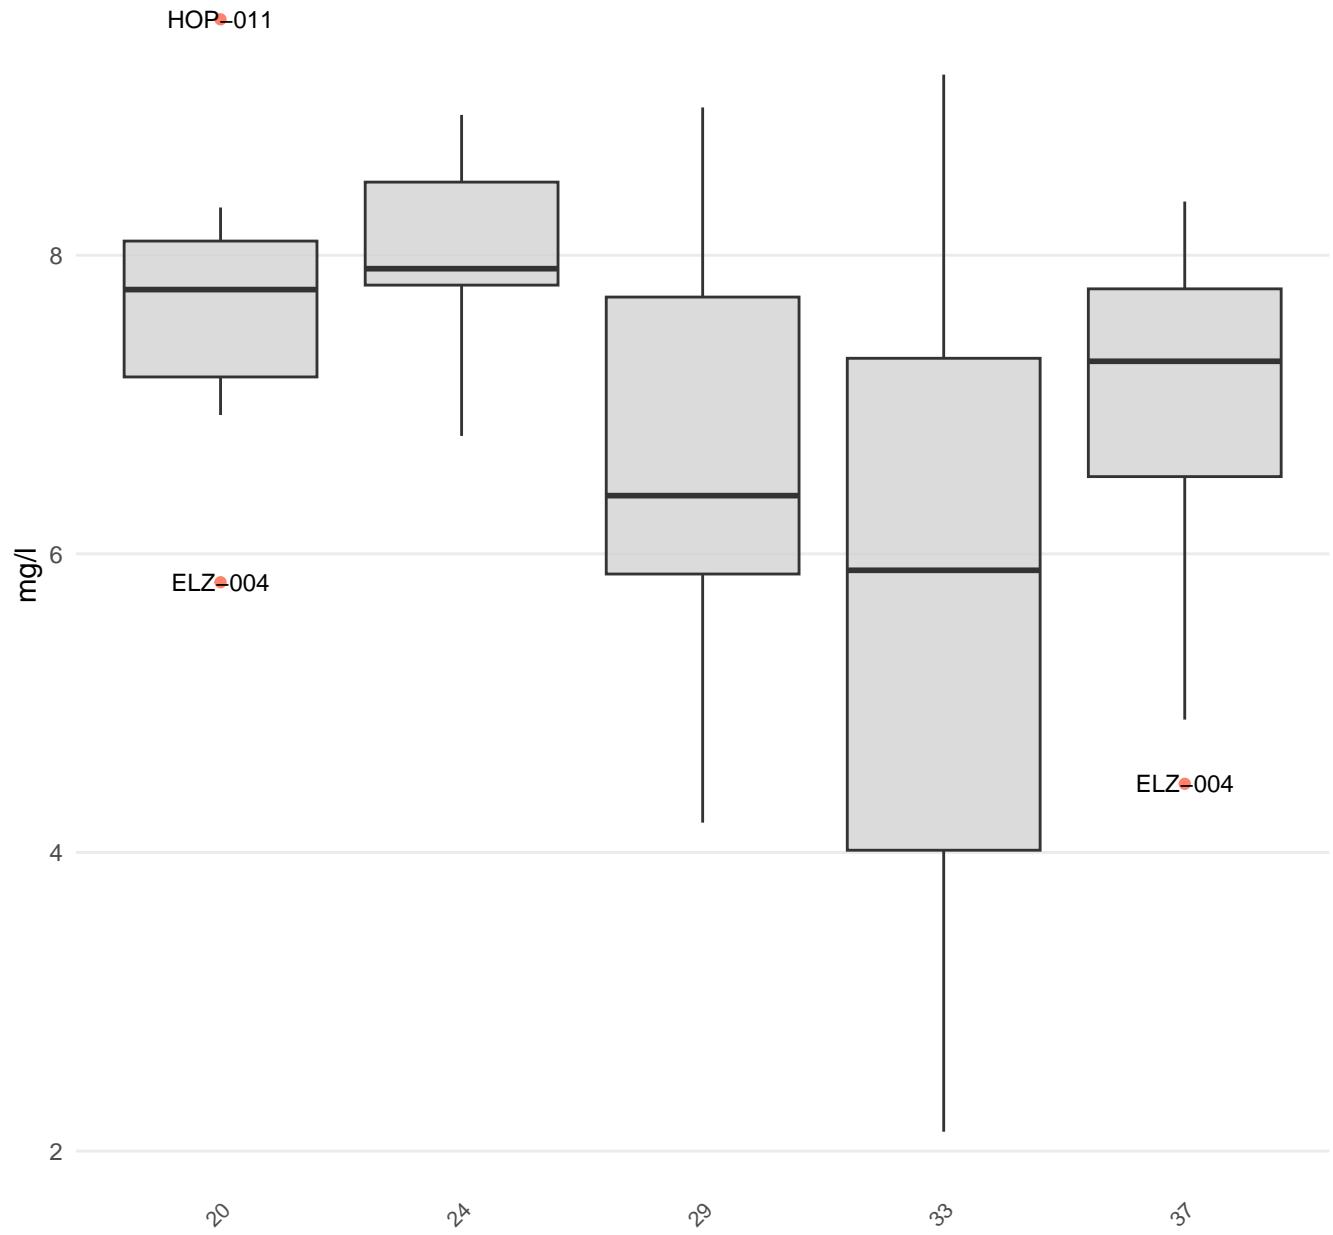


E.coli

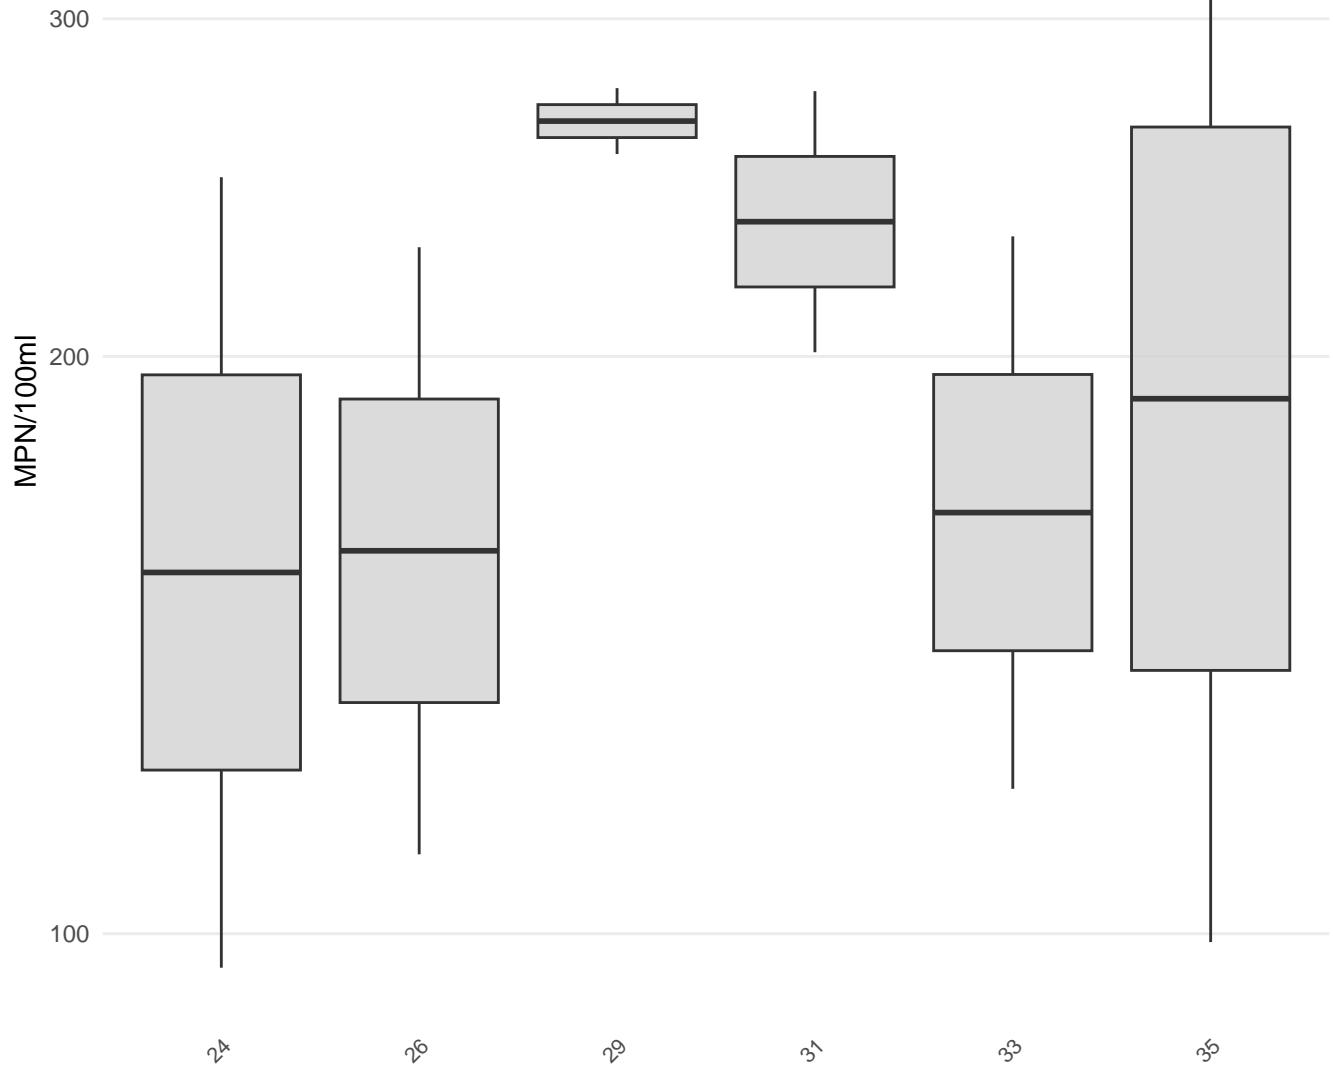


Nitrate

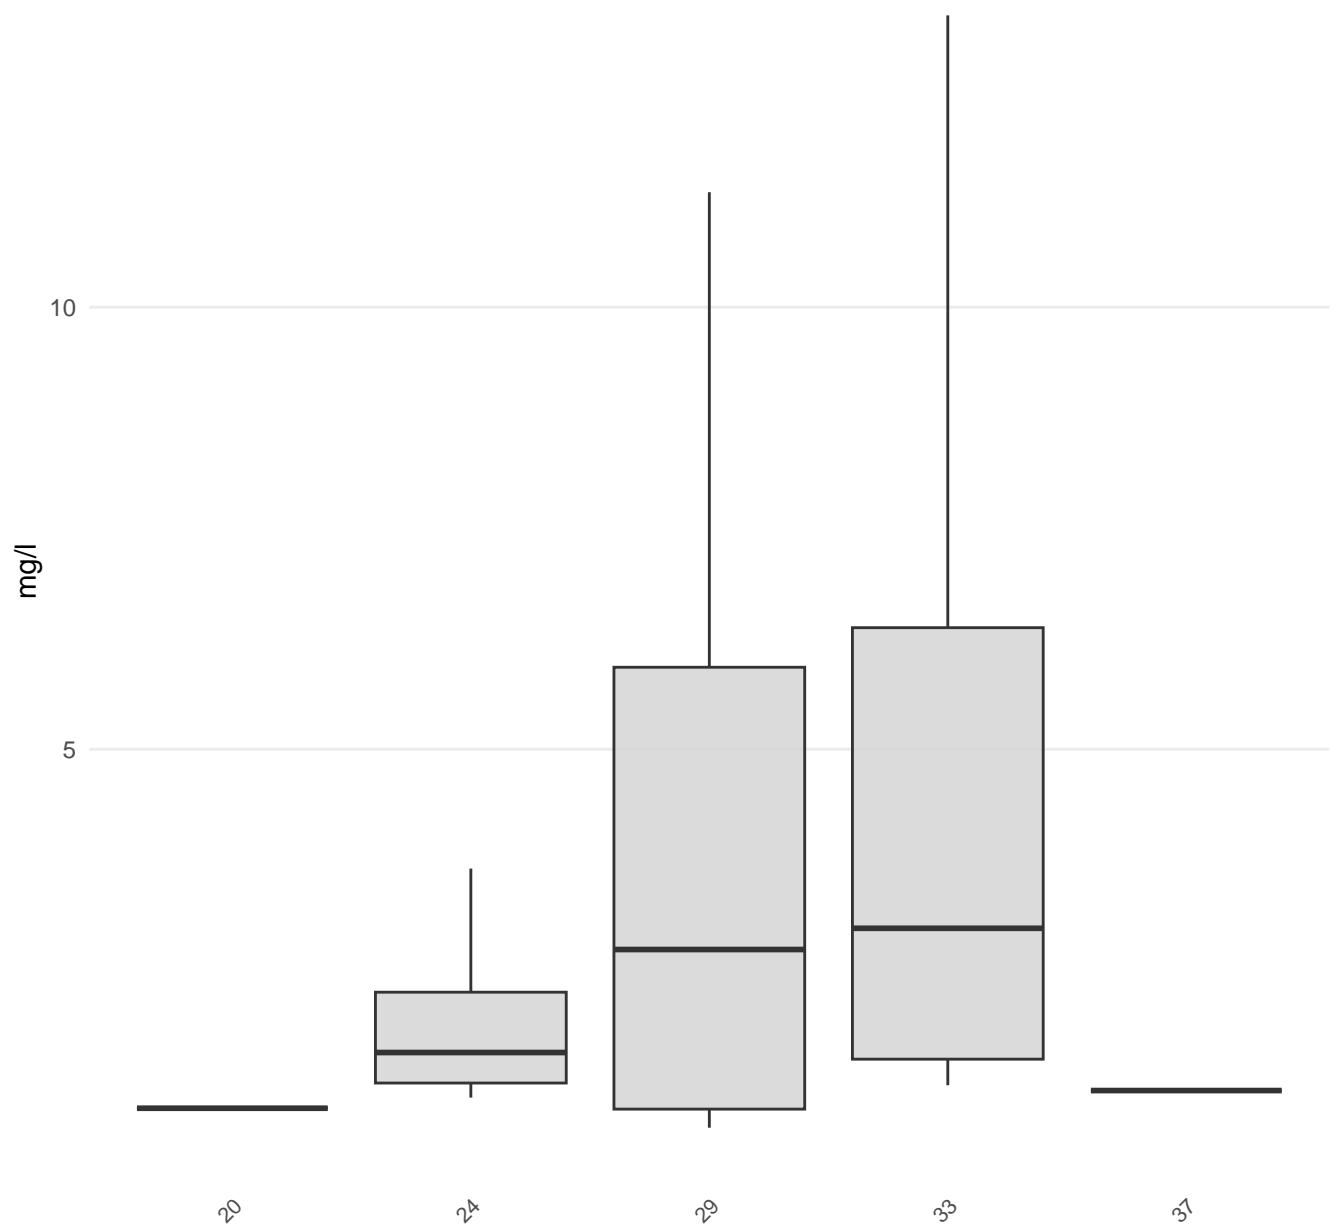


Sp Conductance

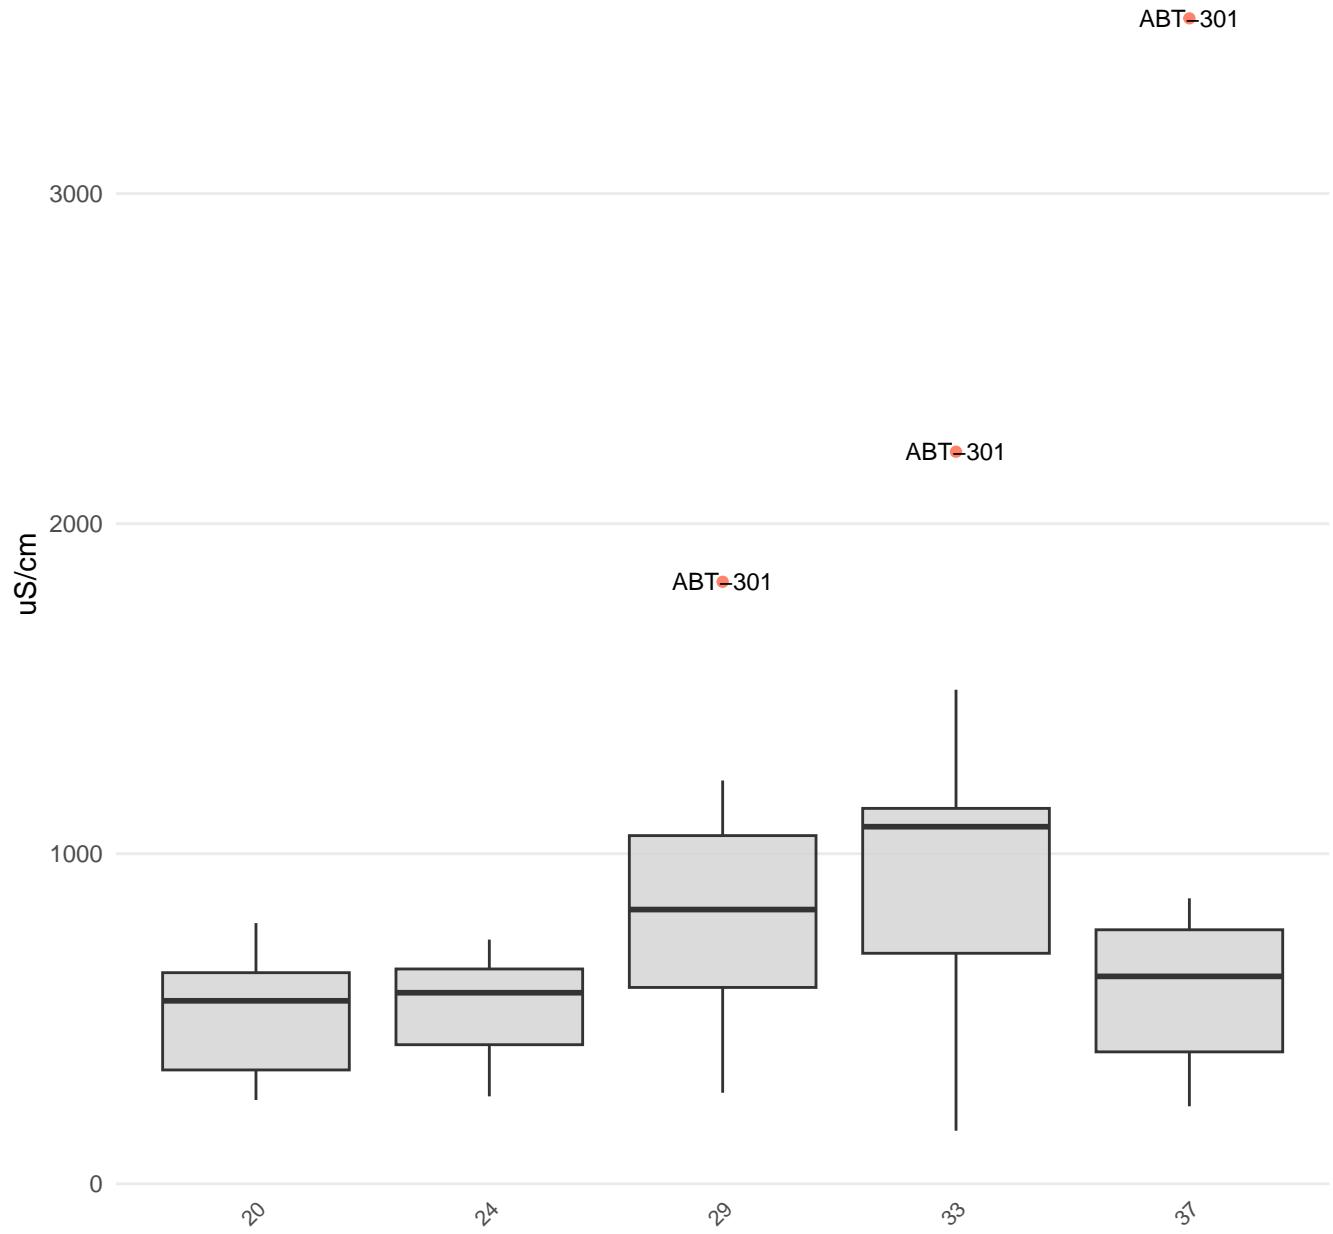


Water Temp

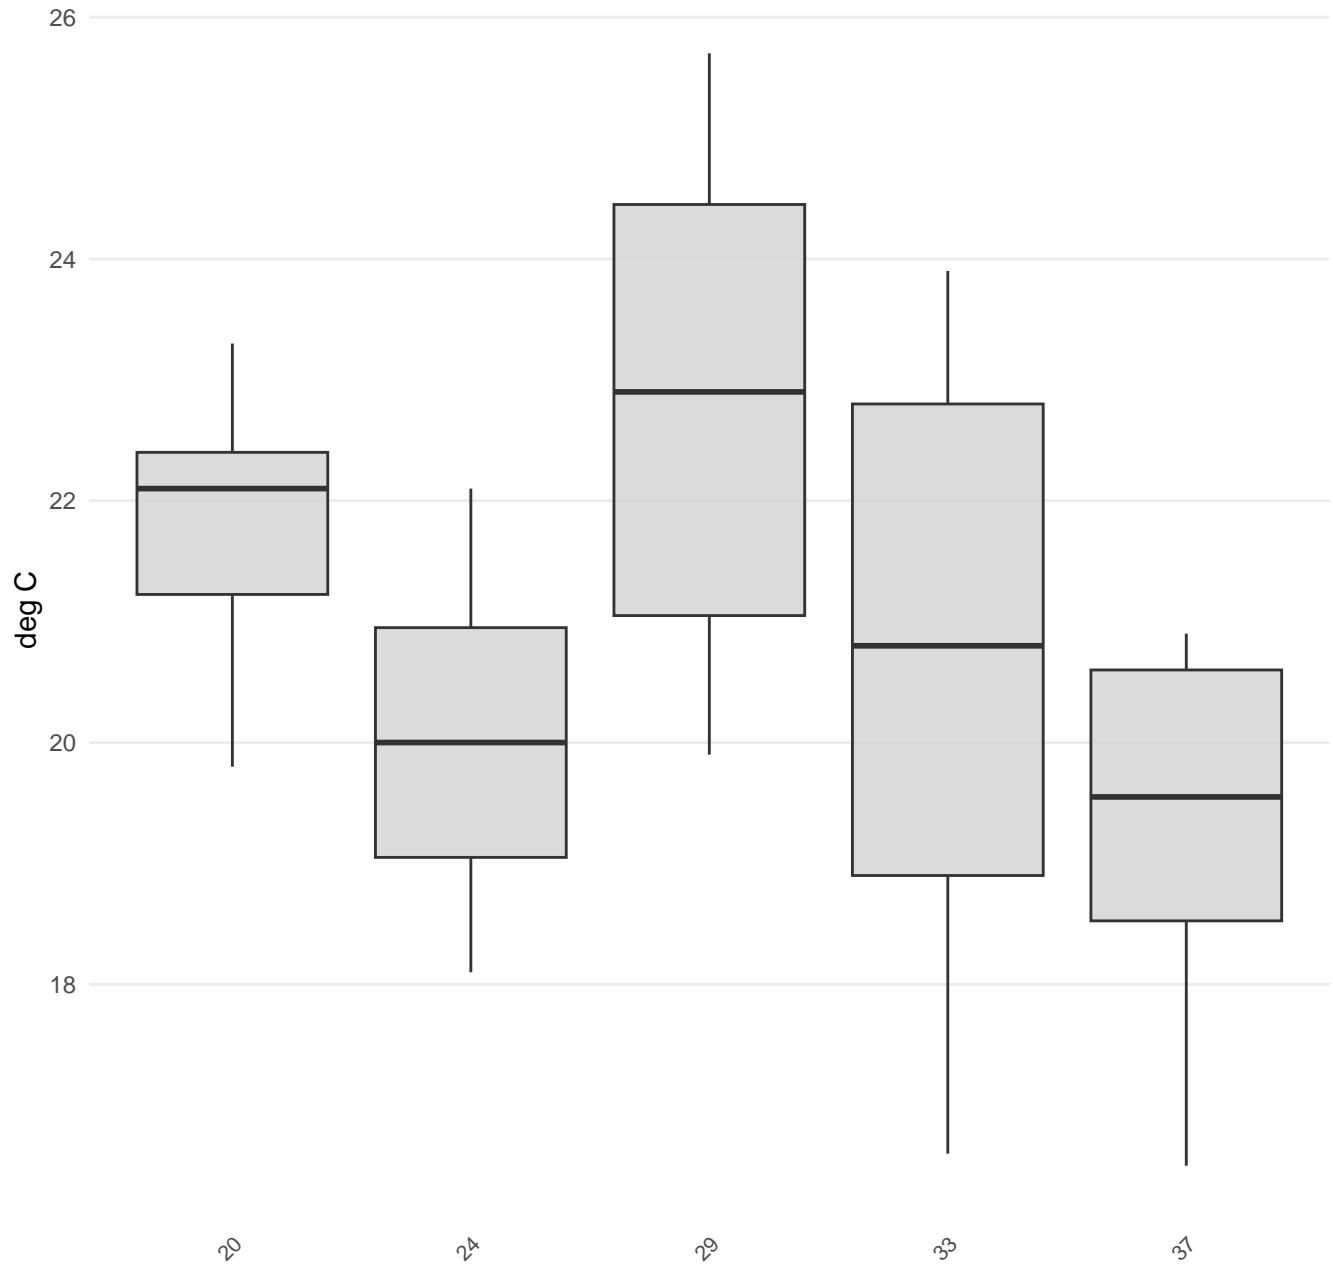


pH

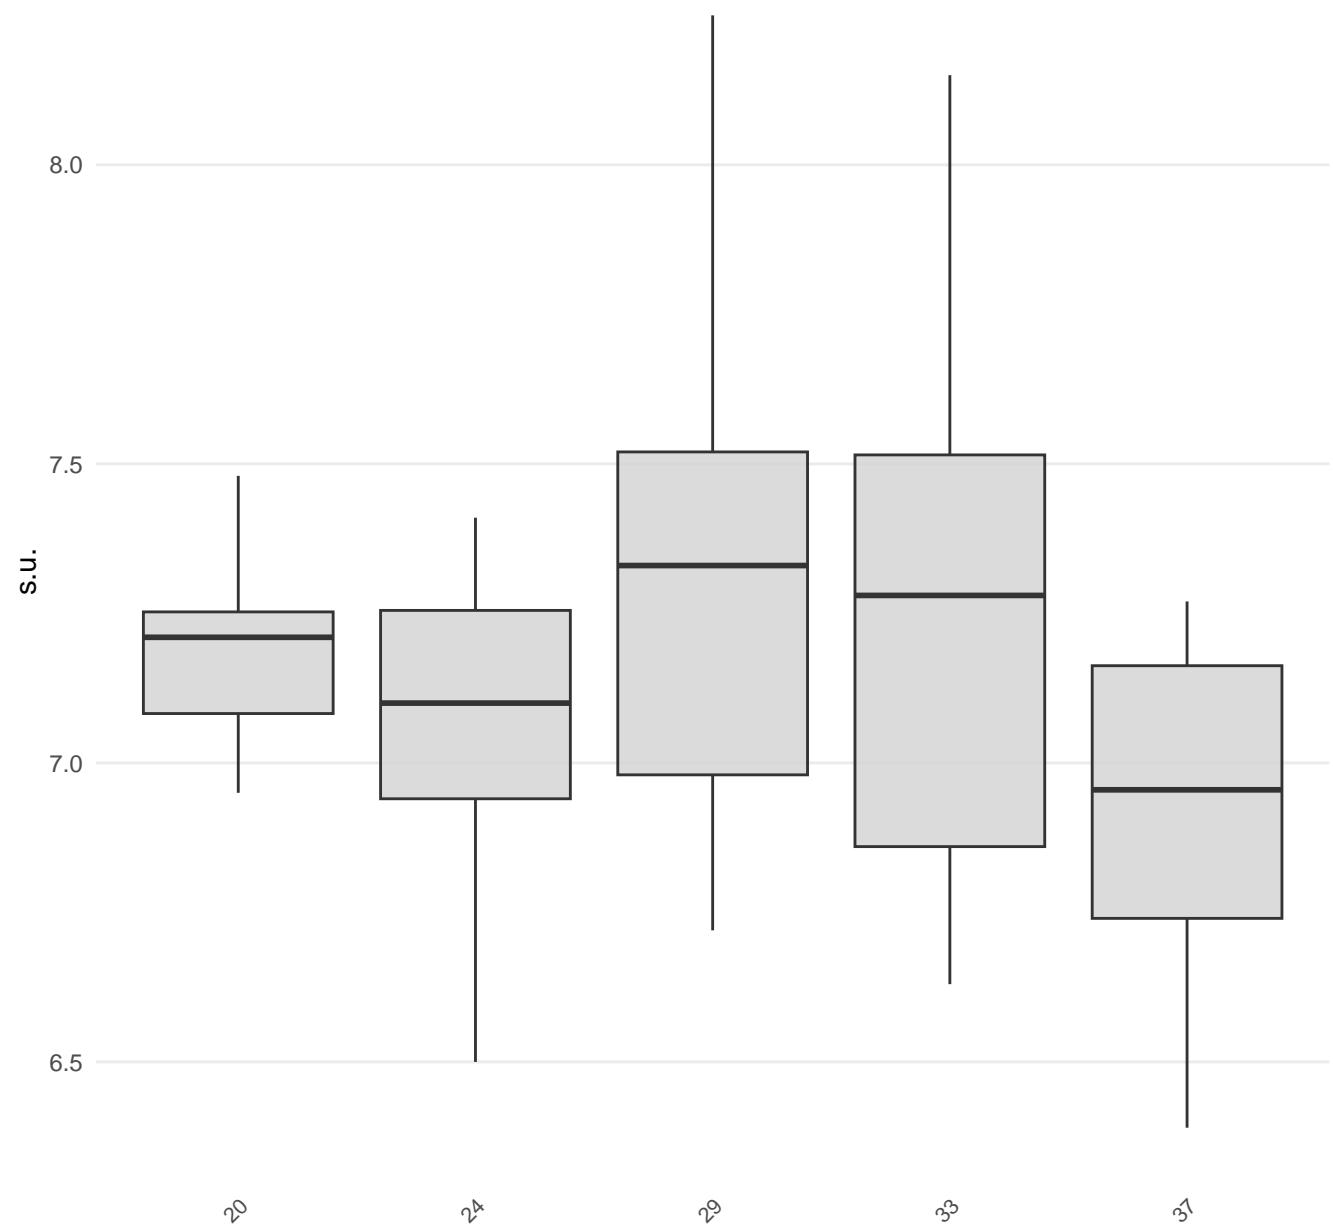


Ammonia

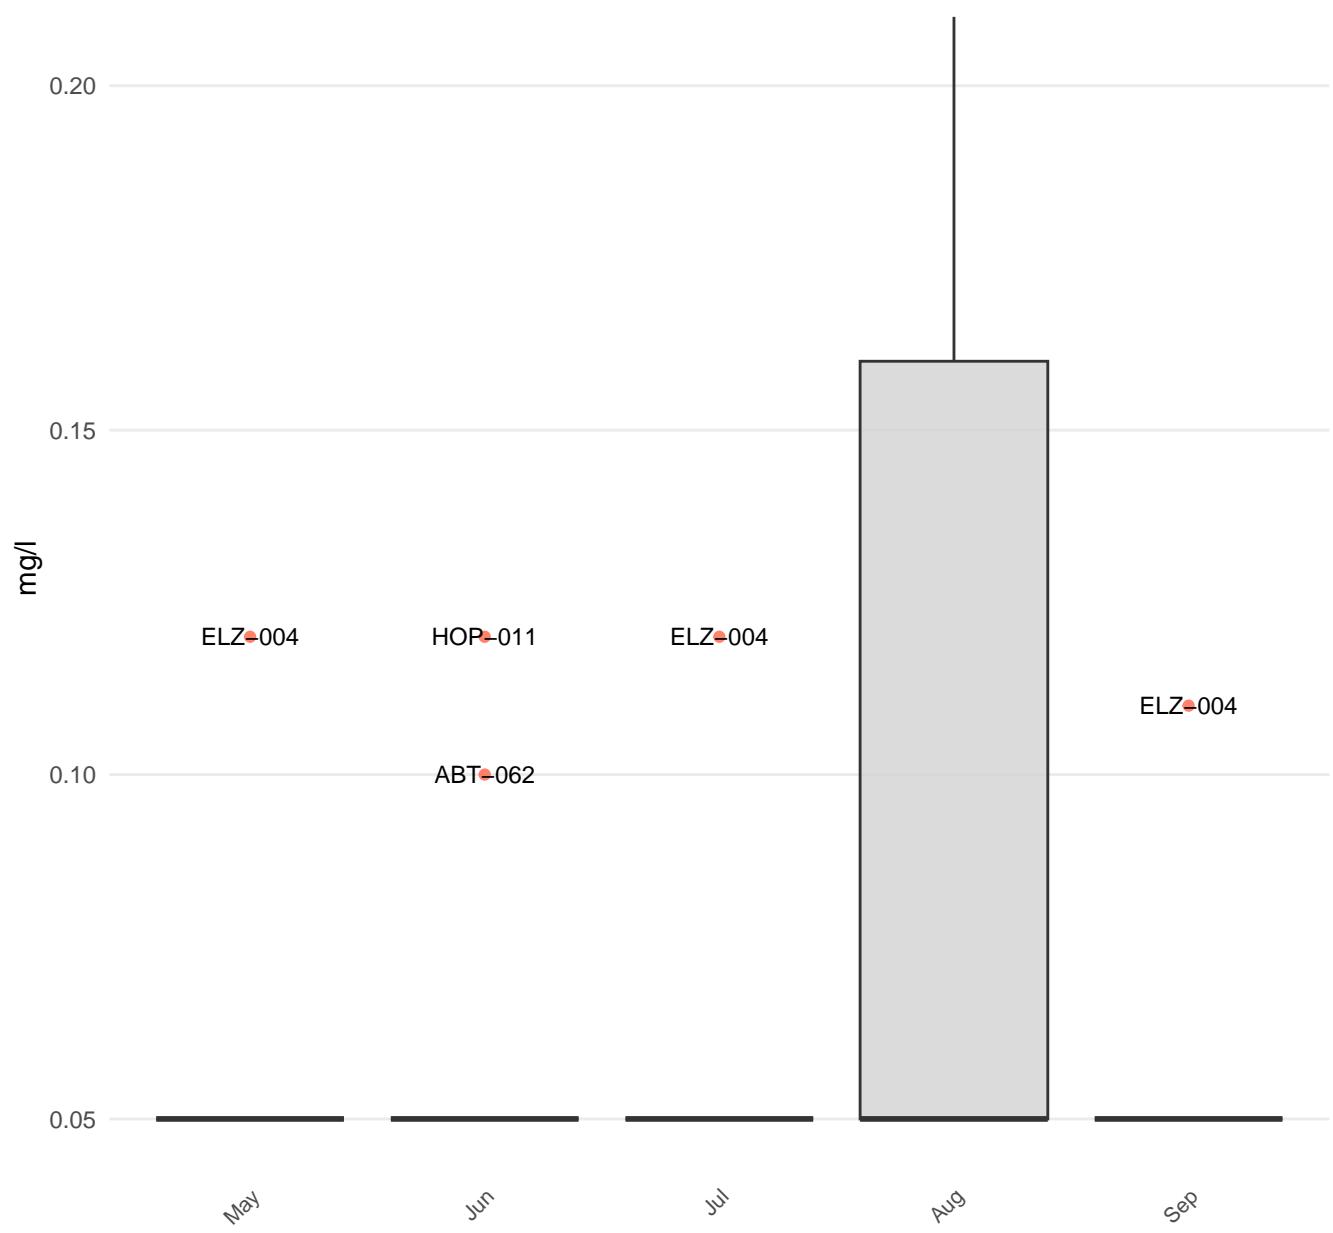


DO

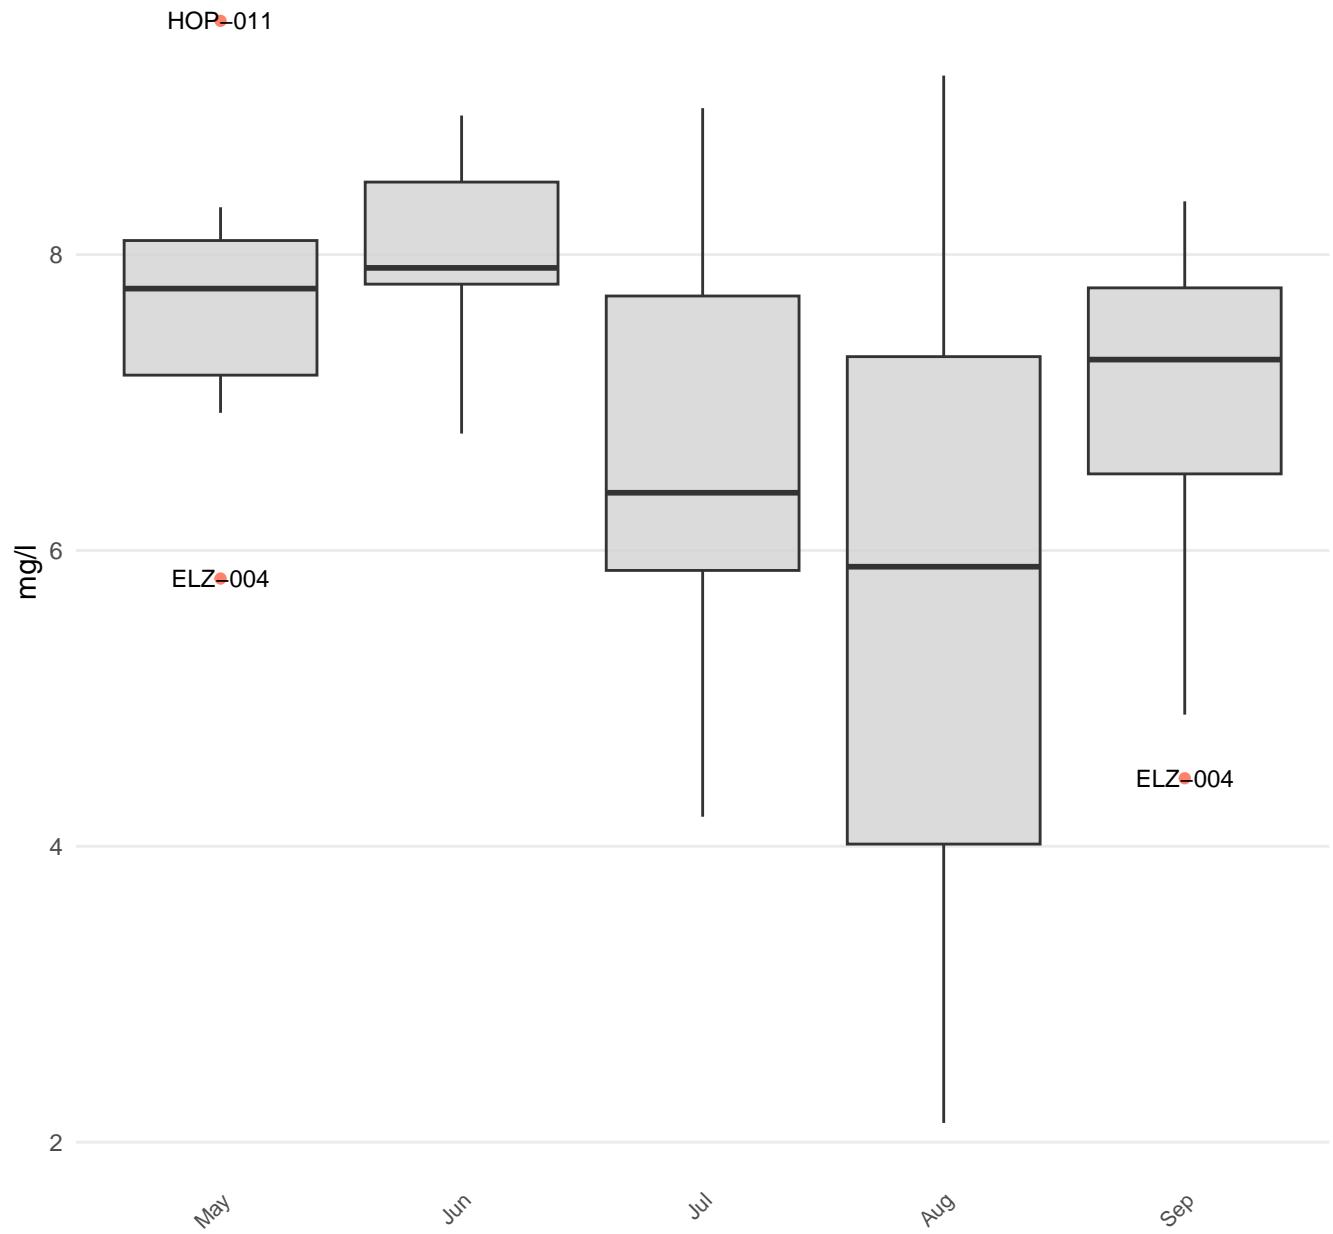


E.coli

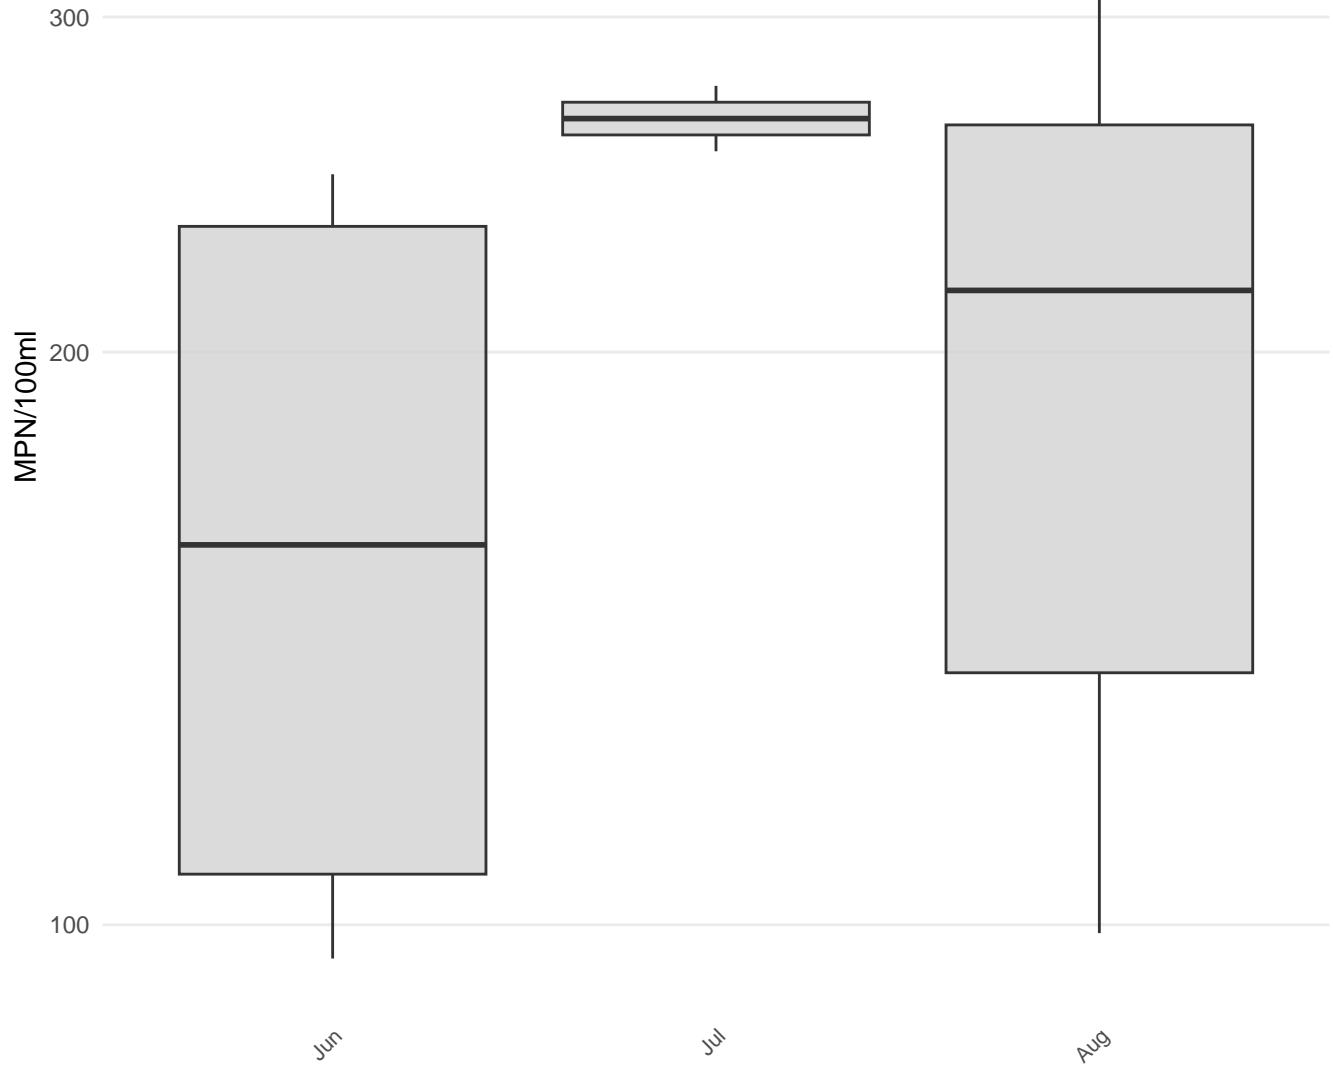


Nitrate

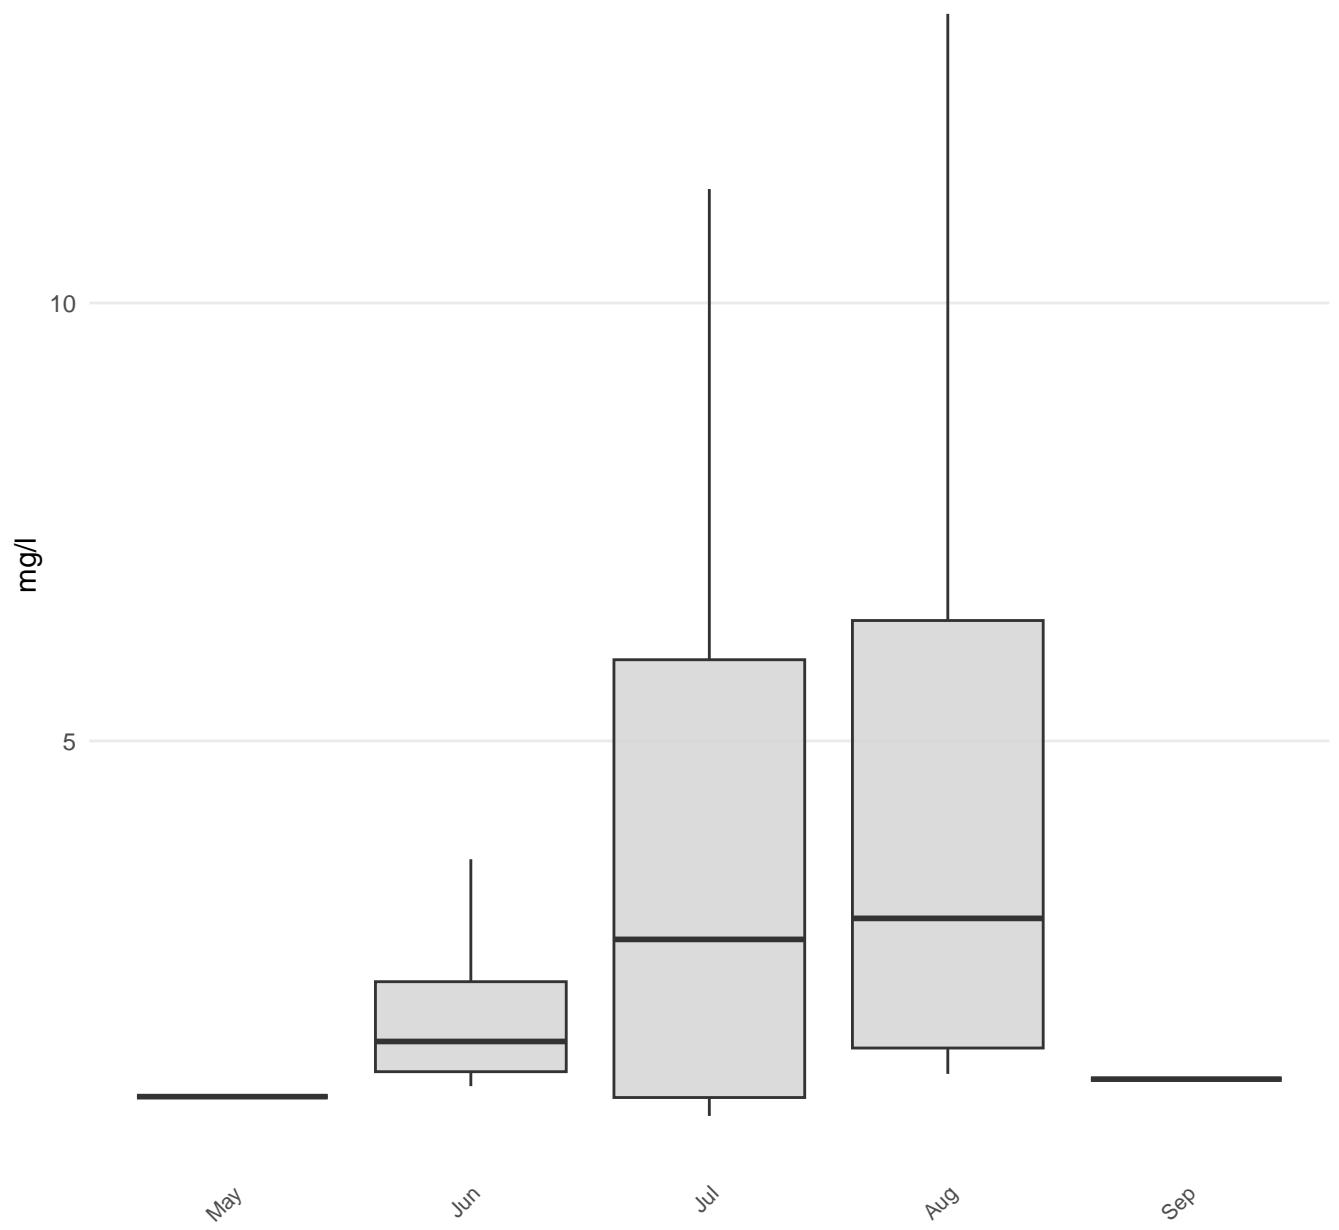


Sp Conductance

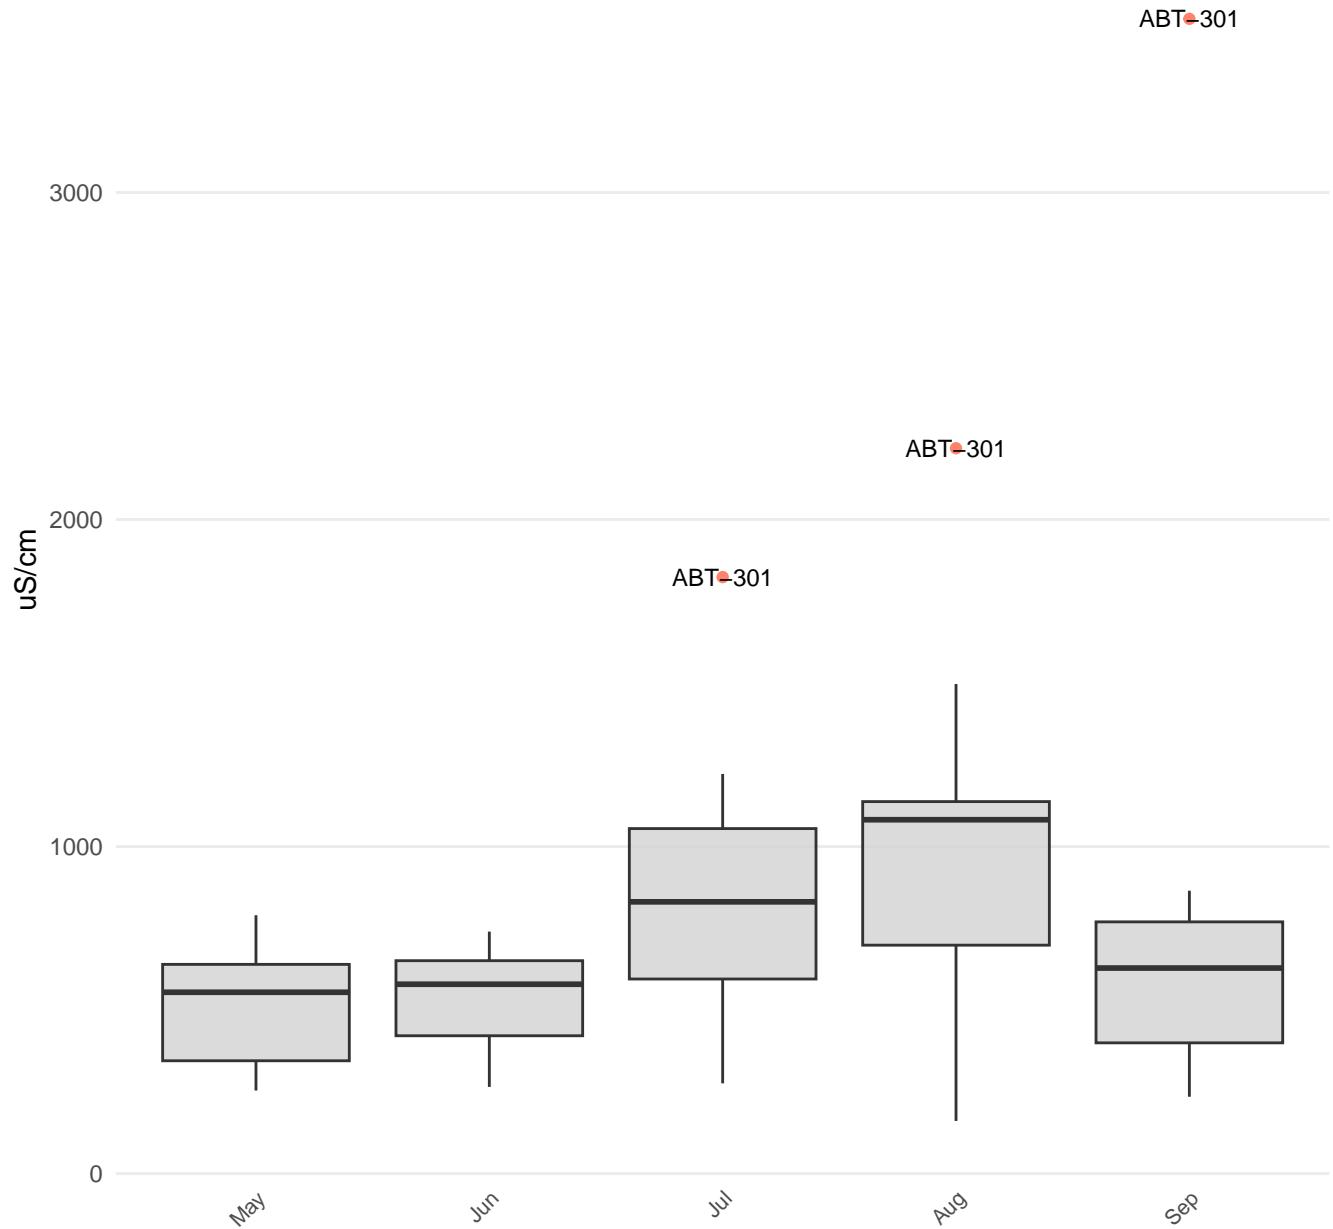

TP

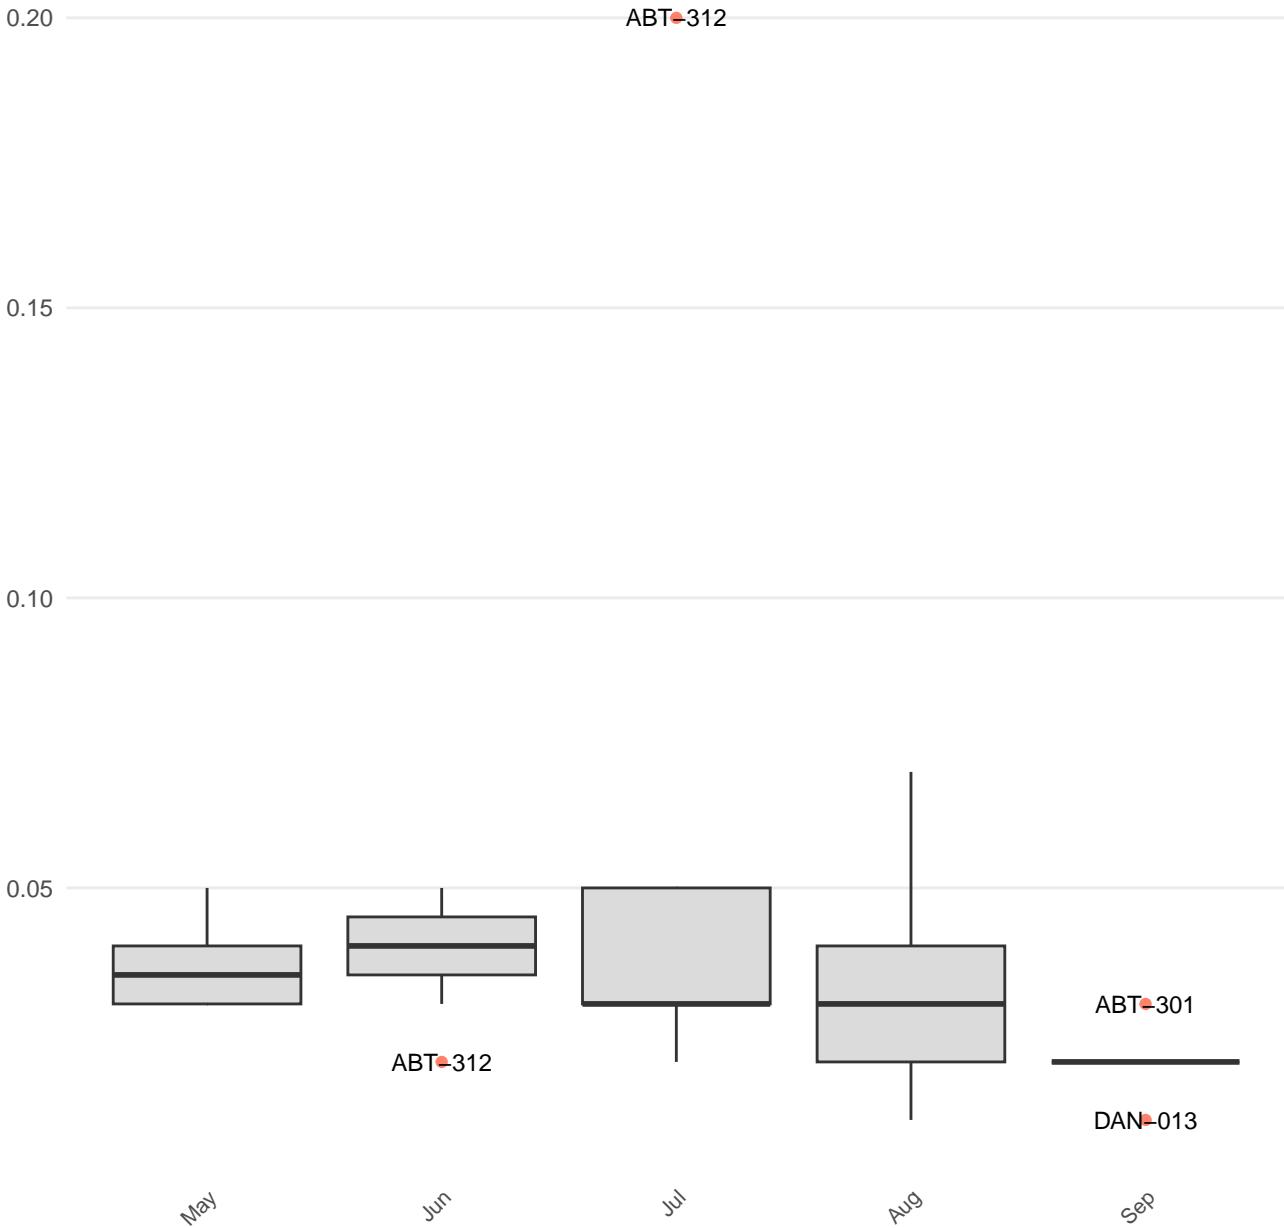

Water Temp

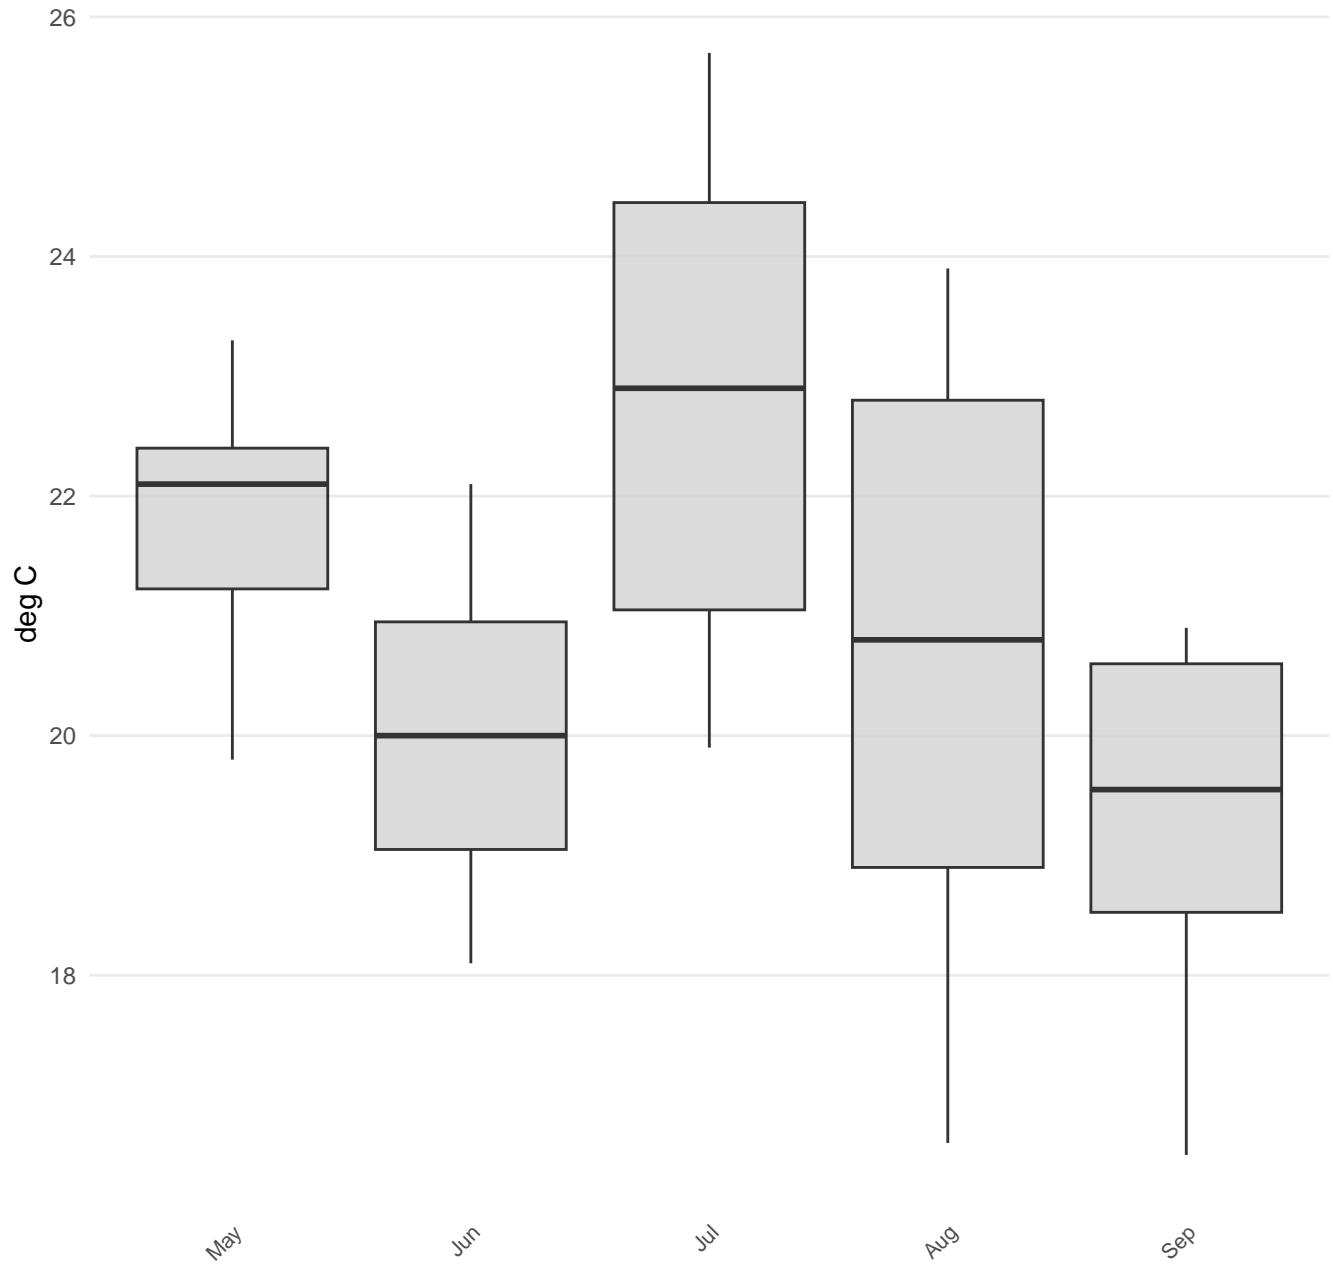

pH

