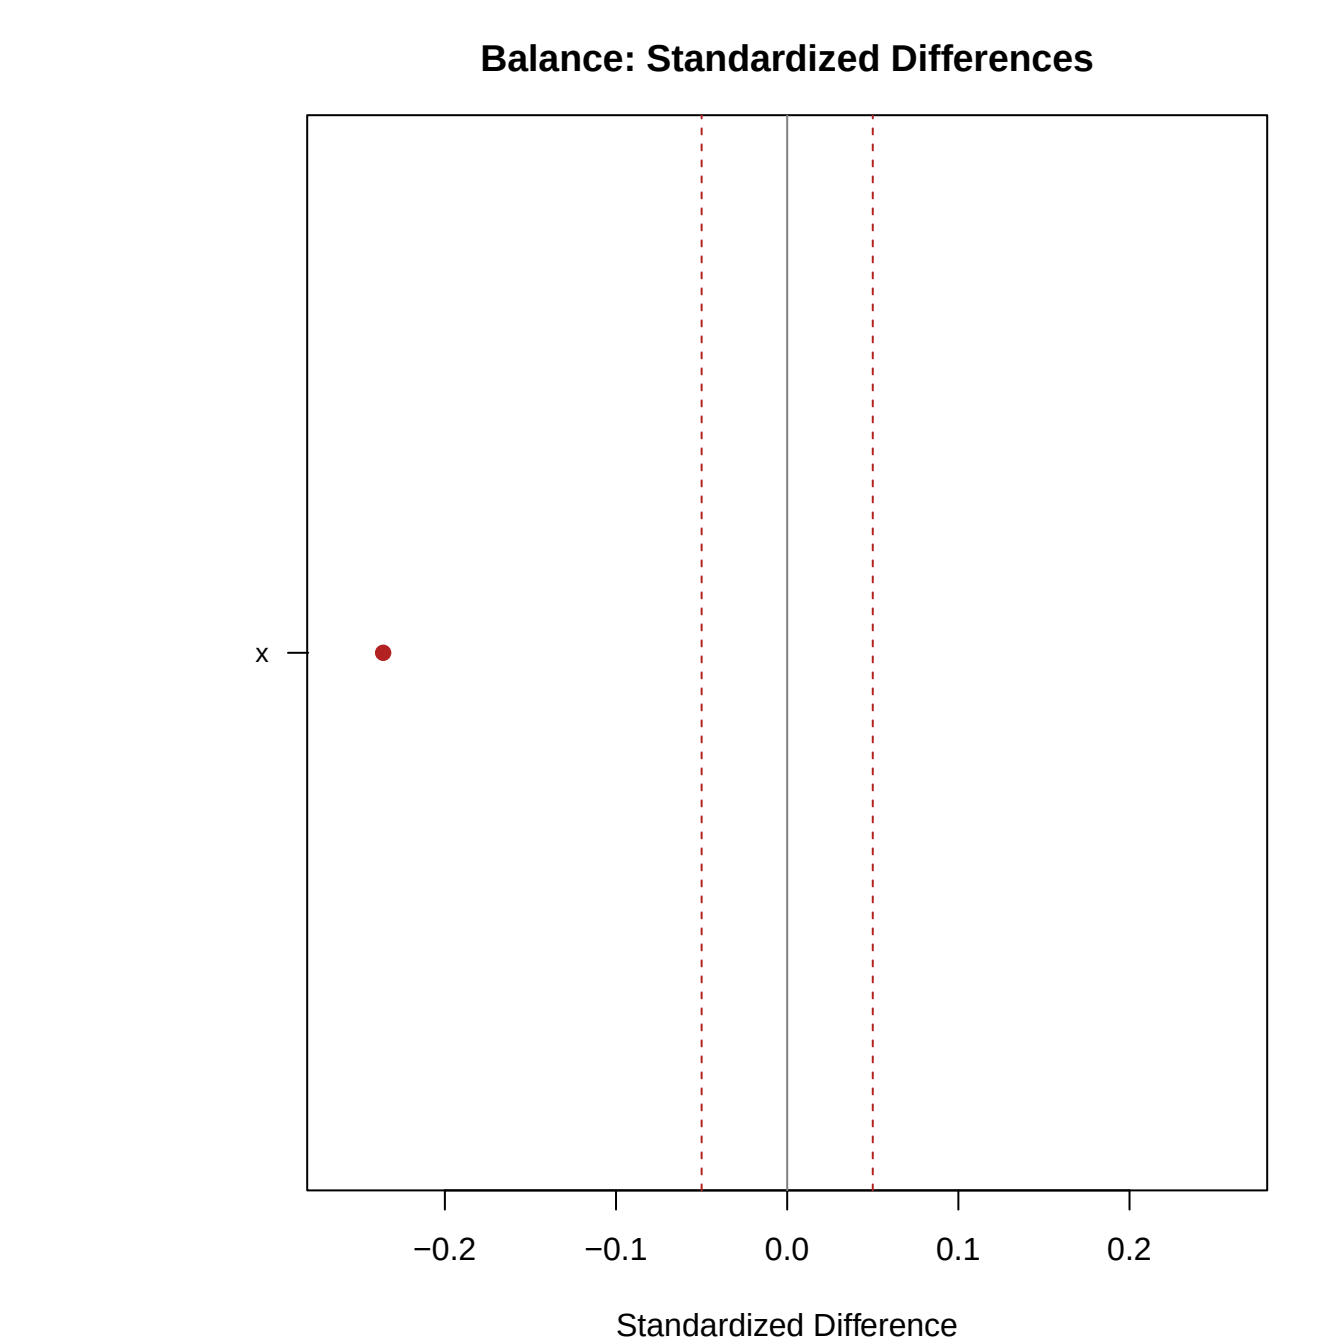
Balance: Standardized Differences
x
−0.2
−0.1
0.0
0.1
0.2
Standardized Difference

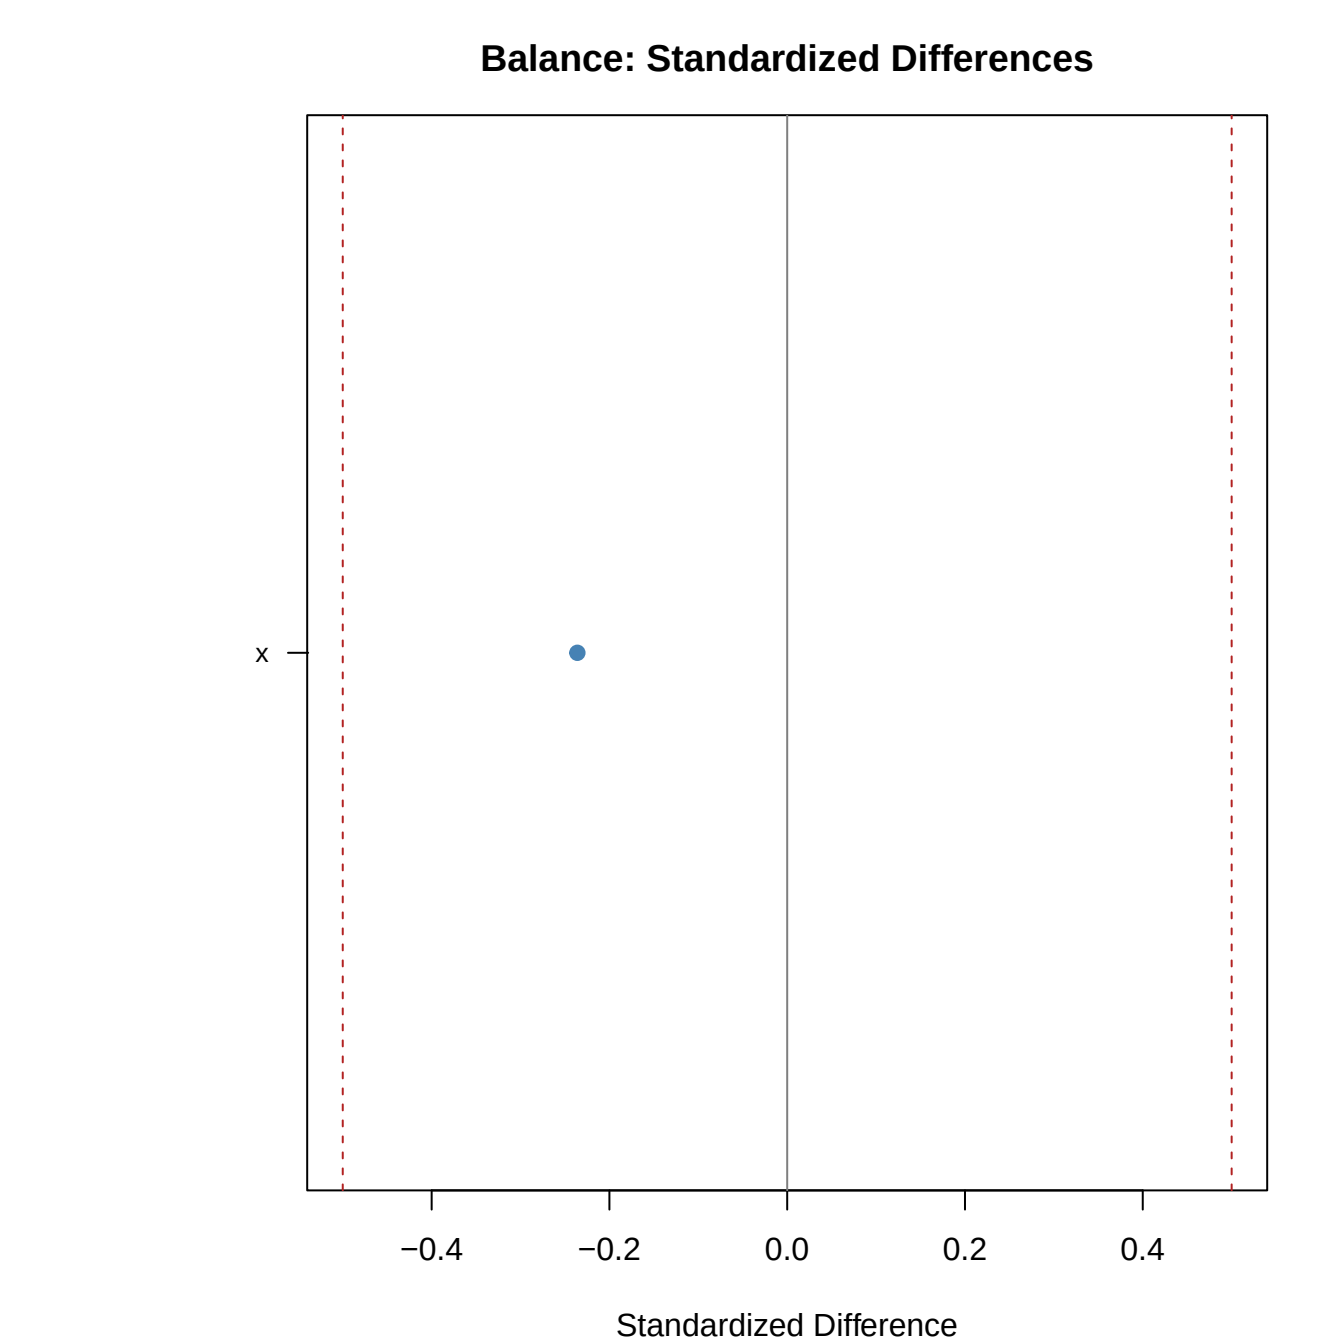
Balance: Standardized Differences
x
−0.4
−0.2
0.0
0.2
0.4
Standardized Difference

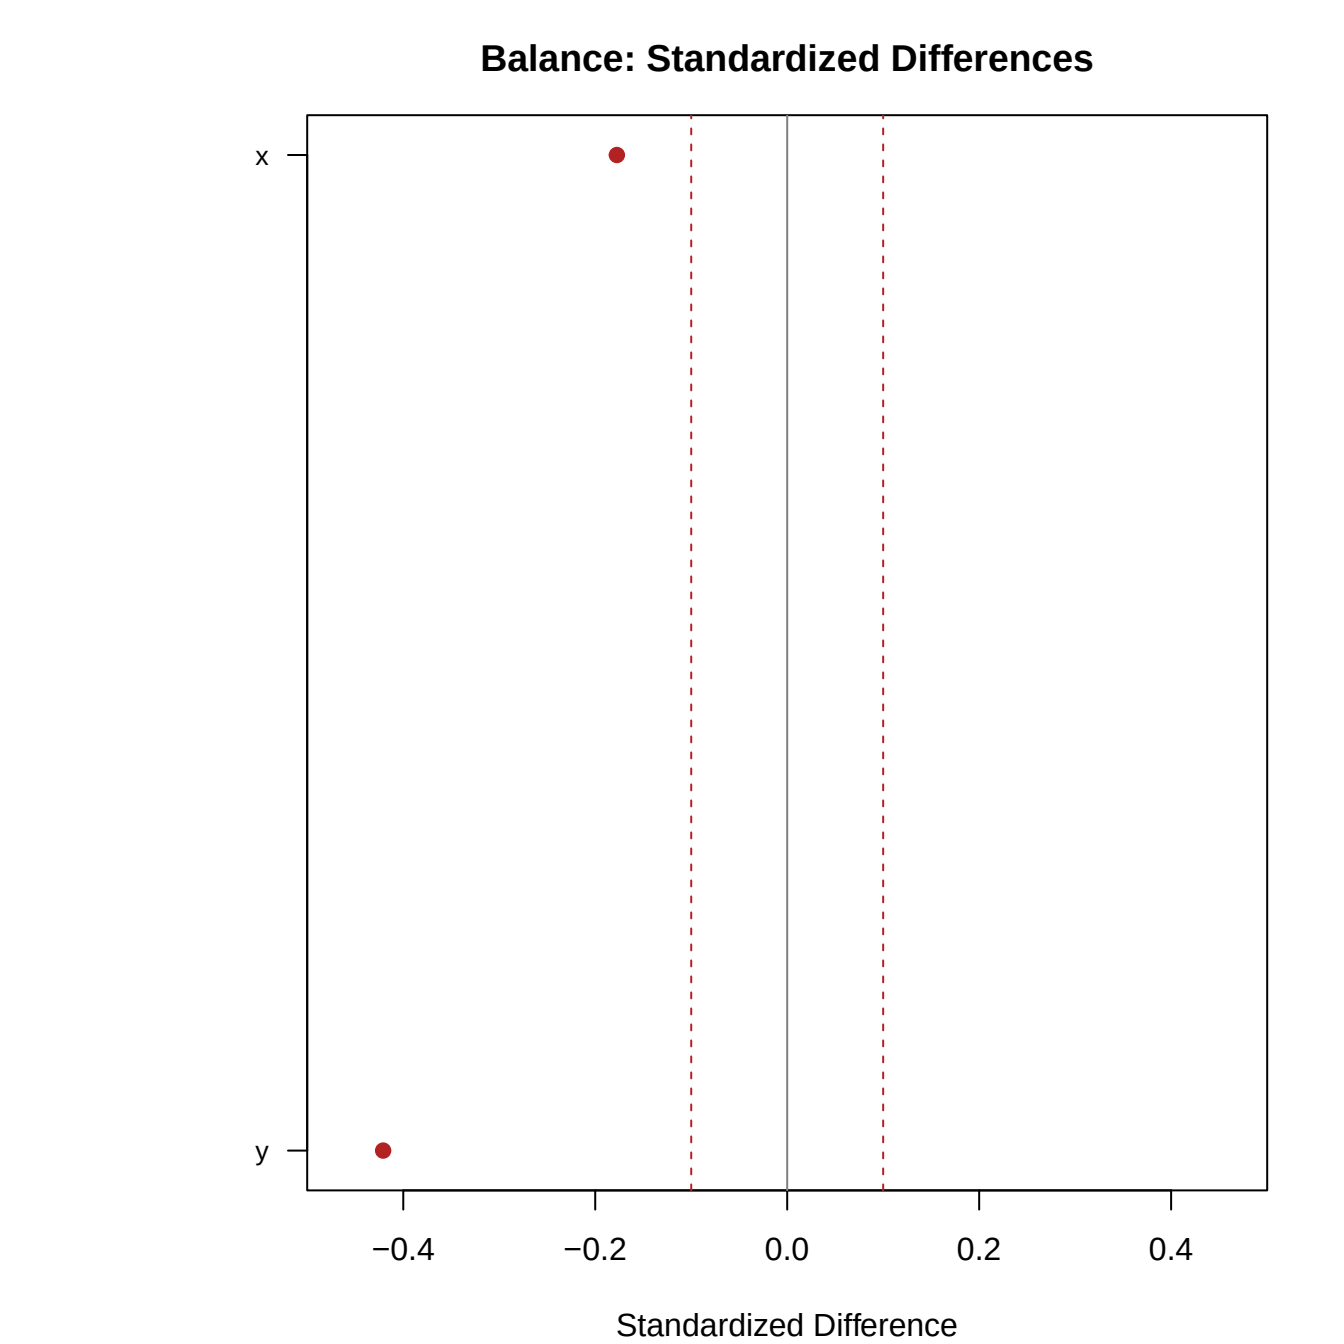
Balance: Standardized Differences
x
y
−0.4
−0.2
0.0
0.2
0.4
Standardized Difference

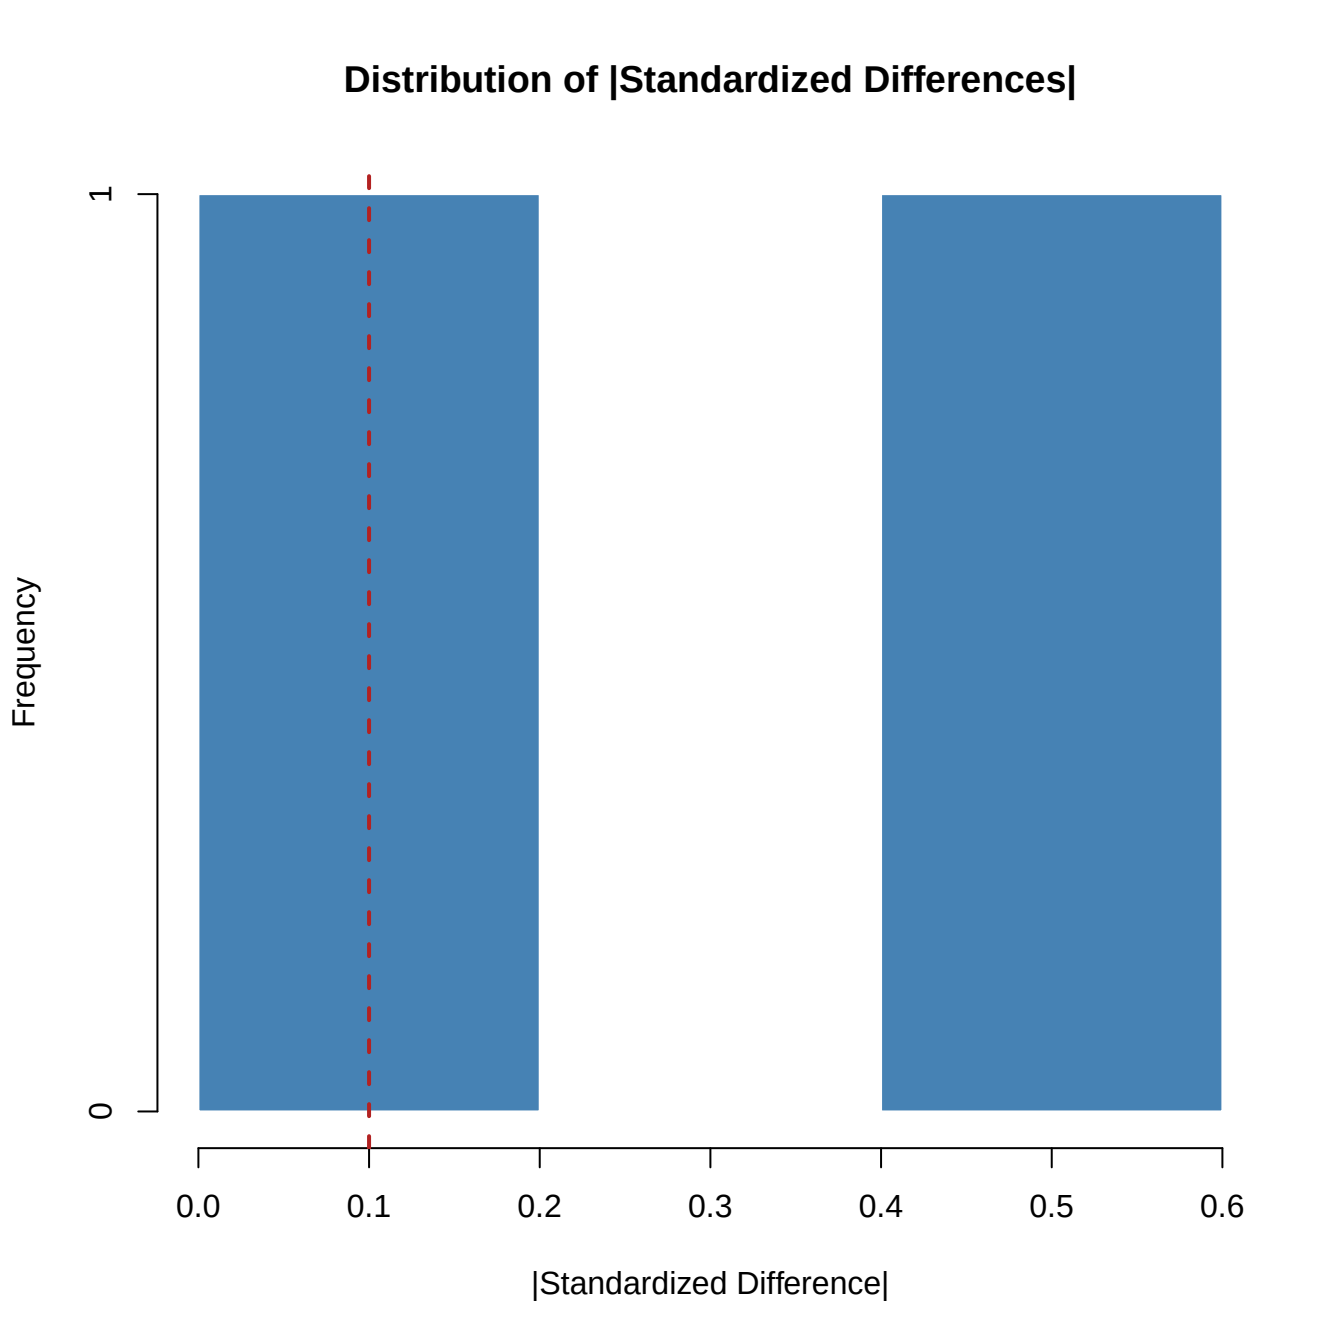
Distribution of |Standardized Differences|
Frequency
1
0
0.0
0.1
0.2
0.3
0.4
0.5
0.6
|Standardized Difference|